

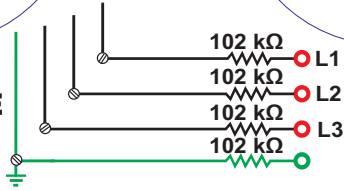


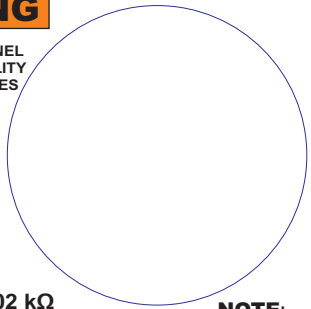

WARNING

QUALIFIED PERSONNEL
FOLLOW YOUR FACILITY
SAFETY PROCEDURES
WHEN USING
THIS DEVICE


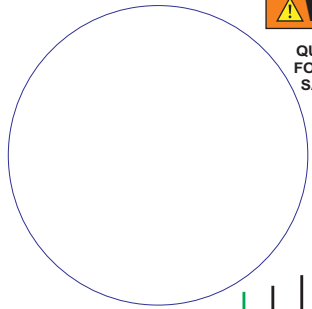


NOTE:
TEST POINT ASSEMBLY
WITH 102 kΩ IMPEDANCE
ON L1, L2, L3 & GND
AFFECTS VOLTAGE
READINGS ± 2%

HINGE

5.83
[148]

30mm Pushbutton
Knock-Out location.
(Flip template over
for opposite hole location.)

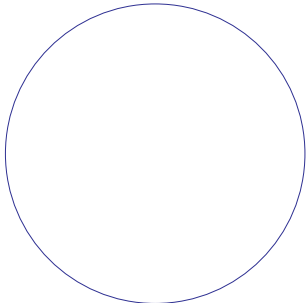

0.26
[6.5]



LATCH

PESD® Template H-TEMPLATE-M-EZ

2.76
[70]