




Ventilation Assessment Summary

Ventilation Assessment

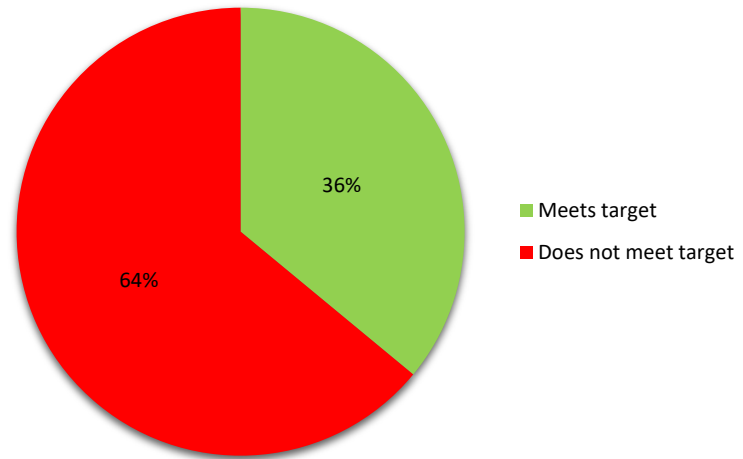

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
1	152	Office	Berkeley City College	BCC	3	1.2	Does not meet target	115	120
2	N/A	Reception Areas	Berkeley City College	BCC	3	1.6	Does not meet target	225	230
3	165	Office	Berkeley City College	BCC	3	1.1	Does not meet target	210	210
4	165A	Office	Berkeley City College	BCC	3	2.1	Does not meet target	16	40
5	124A	Office	Berkeley City College	BCC	3	1.8	Does not meet target	12	40
6	116	Occupiable Storage (D	Berkeley City College	BCC	3	0.0	Does not meet target	203	210
7	126	Computer Lab	Berkeley City College	BCC	3	1.5	Does not meet target	314	320
8	21	Auditorium Seating	Berkeley City College	BCC	3	2.7	Does not meet target	168	170
9	31	Classroom	Berkeley City College	BCC	5	2.0	Does not meet target	305	310
10	32	Classroom	Berkeley City College	BCC	5	1.6	Does not meet target	352	360
11	33	Classroom	Berkeley City College	BCC	5	2.6	Does not meet target	241	250
12	34	Classroom	Berkeley City College	BCC	4	2.3	Does not meet target	182	200
13	53	Classroom	Berkeley City College	BCC	6	0.0	Does not meet target	455	2 x 230
14	54	Classroom	Berkeley City College	BCC	3	0.0	Does not meet target	332	350
15	55	Classroom	Berkeley City College	BCC	5	2.3	Does not meet target	363	400
16	212	Classroom	Berkeley City College	BCC	4	2.3	Does not meet target	315	320
17	213	Computer Lab	Berkeley City College	BCC	3	1.7	Does not meet target	372	400
18	214	Classroom	Berkeley City College	BCC	5	2.8	Does not meet target	295	300

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
19	216	Classroom	Berkeley City College	BCC	5	4.6	Does not meet target	39	40
20	218	Media Center	Berkeley City College	BCC	3	2.4	Does not meet target	134	140
21	223	Classroom	Berkeley City College	BCC	3	1.4	Does not meet target	247	250
22	226	Classroom	Berkeley City College	BCC	3	1.4	Does not meet target	258	320
23	227	Computer Lab	Berkeley City College	BCC	3	1.6	Does not meet target	378	70
24	203	Reception Areas	Berkeley City College	BCC	3	2.3	Does not meet target	87	100
25	266	Conference	Berkeley City College	BCC	3	0.0	Does not meet target	59	60
26	Class 3	Classroom	Berkeley City College	BCC	4	1.9	Does not meet target	558	2 x 280
27	Class 1	Classroom	Berkeley City College	BCC	5	3.9	Does not meet target	159	170
28	345	Office	Berkeley City College	BCC	3	1.7	Does not meet target	18	40
29	347	Office	Berkeley City College	BCC	3	1.5	Does not meet target	84	100
30	356	Office	Berkeley City College	BCC	3	1.2	Does not meet target	190	200
31	353	Office	Berkeley City College	BCC	3	1.4	Does not meet target	69	70
32	355	Office	Berkeley City College	BCC	3	1.2	Does not meet target	82	100
33	341A	Conference	Berkeley City College	BCC	3	2.2	Does not meet target	119	120
34	341B	Office	Berkeley City College	BCC	3	1.8	Does not meet target	30	40
35	311	Classroom	Berkeley City College	BCC	5	4.0	Does not meet target	122	140
36	312	Computer Lab	Berkeley City College	BCC	3	1.1	Does not meet target	545	2 x 280
37	313	Computer Lab	Berkeley City College	BCC	3	1.5	Does not meet target	655	2 x 330
38	315	Classroom	Berkeley City College	BCC	5	1.3	Does not meet target	533	2 x 270
39	322	Classroom	Berkeley City College	BCC	4	1.5	Does not meet target	366	400
40	323	Computer Lab	Berkeley City College	BCC	3	1.9	Does not meet target	310	310
41	324	Computer Lab	Berkeley City College	BCC	3	1.0	Does not meet target	543	2 x 280
42	411	Classroom	Berkeley City College	BCC	3	0.0	Does not meet target	711	2 x 400
43	413	Classroom	Berkeley City College	BCC	4	3.3	Does not meet target	150	170
44	421	Classroom	Berkeley City College	BCC	4	2.2	Does not meet target	277	280
45	423	Classroom	Berkeley City College	BCC	3	2.2	Does not meet target	123	140
46	431	Classroom	Berkeley City College	BCC	3	1.7	Does not meet target	510	2 x 270
47	518	Classroom	Berkeley City College	BCC	3	0.6	Does not meet target	478	2 x 240
48	451B	Conference	Berkeley City College	BCC	3	2.6	Does not meet target	33	40
49	561	Workroom	Berkeley City College	BCC	3	3.0	Meets target	0	
50	151	Office	Berkeley City College	BCC	3	3.1	Meets target	0	

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
51	131-131A	Library	Berkeley City College	BCC	3	3.4	Meets target	0	
52	114	Office	Berkeley City College	BCC	3	6.7	Meets target	0	
53	122	Office	Berkeley City College	BCC	3	4.1	Meets target	0	
54	112	Library	Berkeley City College	BCC	3	12.0	Meets target	0	
55	21A	Computer	Berkeley City College	BCC	3	38.9	Meets target	0	
56	52	Classroom	Berkeley City College	BCC	5	5.6	Meets target	0	
57	51	Classroom	Berkeley City College	BCC	5	11.3	Meets target	0	
58	242	Office	Berkeley City College	BCC	3	3.7	Meets target	0	
59	243	Office	Berkeley City College	BCC	3	3.0	Meets target	0	
60	244	Office	Berkeley City College	BCC	3	3.1	Meets target	0	
61	251	Office	Berkeley City College	BCC	3	4.0	Meets target	0	
62	Class 2	Classroom	Berkeley City College	BCC	4	4.0	Meets target	0	
63	Wellness	Office	Berkeley City College	BCC	3	3.2	Meets target	0	
64	352	Office	Berkeley City College	BCC	3	3.0	Meets target	0	
65	316	Classroom	Berkeley City College	BCC	4	4.0	Meets target	0	
66	321	Science Lab	Berkeley City College	BCC	4	11.7	Meets target	0	
67	450	Office	Berkeley City College	BCC	3	9.9	Meets target	0	
68	451A	Conference	Berkeley City College	BCC	3	4.5	Meets target	0	
69	422	Classroom	Berkeley City College	BCC	4	6.5	Meets target	0	
70	424	Classroom	Berkeley City College	BCC	3	3.1	Meets target	0	
71	514	Classroom	Berkeley City College	BCC	3	13.0	Meets target	0	
72	522	Science Lab	Berkeley City College	BCC	3	8.1	Meets target	0	
73	561	Office	Berkeley City College	BCC	3	3.0	Meets target	0	
74	521	Science Lab	Berkeley City College	BCC	3	17.8	Meets target	0	
75	513	Science Lab	Berkeley City College	BCC	3	6.0	Meets target	0	