




Ventilation Assessment Summary

Ventilation Assessment

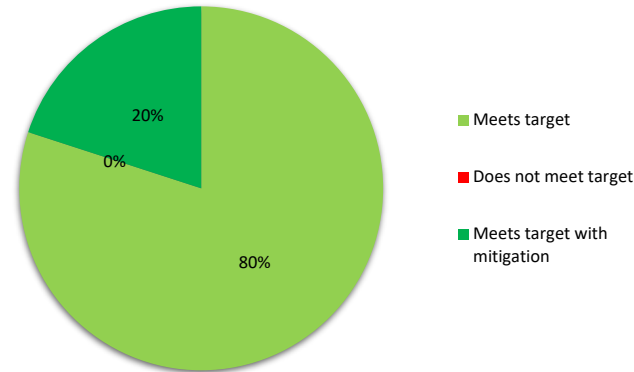

#	HVAC		Site		Air Changes			Reccommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	A136	Office	College of Alameda	A	5	60.6	Meets target	0	32	0
2	A135	Office	College of Alameda	A	3	34.8	Meets target	0	39	0
3	A134	Office	College of Alameda	A	3	36.3	Meets target	0	39	0
4	A133	Office	College of Alameda	A	3	41.5	Meets target	0	39	0
5	A132	Office	College of Alameda	A	3	7.1	Meets target	0	37	0
6	A131	Classroom	College of Alameda	A	3	12.0	Meets target	0	37	0
7	A130	Office	College of Alameda	A	3	14.9	Meets target	0	37	0
8	A129	Office	College of Alameda	A	3	14.9	Meets target	0	37	0
9	A113	Office	College of Alameda	A	3	23.0	Meets target with mitigation	103	140	950
10	A113	Office	College of Alameda	A	3	6.6	Meets target	0	79	0
11	A109	Office	College of Alameda	A	3	10.1	Meets target	0	37	0
12	A128	Office	College of Alameda	A	3	11.9	Meets target	0	37	0
13	A105	Office	College of Alameda	A	3	3.5	Meets target with mitigation	142	156	167
14	A103	Office	College of Alameda	A	3	10.9	Meets target	0	132	0
15	A102	Office	College of Alameda	A	3	20.5	Meets target	0	64	0
16	Engineering Lobby 1	Lobby	College of Alameda	A	3	9.5	Meets target	0	2423	2970
17	A108	Office	College of Alameda	A	3	10.2	Meets target	0	37	0
18	A107	Office	College of Alameda	A	3	11.5	Meets target	0	36	0
19	A115	Office	College of Alameda	A	3	11.5	Meets target with mitigation	14	59	167
20	A104A	Office	College of Alameda	A	3	7.9	Meets target	0	45	0
21	A151	Office	College of Alameda	A	3	9.7	Meets target	0	145	0
22	A149	Conference	College of Alameda	A	3	8.2	Meets target	0	139	0
23	A147	Office	College of Alameda	A	3	13.1	Meets target	0	77	0
24	A146	Office	College of Alameda	A	3	13.4	Meets target	0	58	0
25	A145	Office	College of Alameda	A	3	11.9	Meets target	0	76	0
26	A144	Conference	College of Alameda	A	3	10.1	Meets target	0	88	0

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
27	A143	Office	College of Alameda	A	3	8.7	Meets target	0	142	0
28	A141	Office	College of Alameda	A	3	5.8	Meets target	0	80	0
29	A138	Office	College of Alameda	A	3	7.8	Meets target	0	184	0
30	A148	Office	College of Alameda	A	3	11.6	Meets target	0	50	0
31	A150/A152/A	Office	College of Alameda	A	3	6.2	Meets target	0	435	0
32	A226	Break room	College of Alameda	A	3	7.0	Meets target	0	167	0
33	A227	Office	College of Alameda	A	3	5.4	Meets target	0	208	0
34	A228	Computer Lab	College of Alameda	A	3	5.3	Meets target	0	320	120
35	A225	Computer Lab	College of Alameda	A	3	5.0	Meets target	0	614	120
36	A129A	Lobby	College of Alameda	A	3	6.3	Meets target with mitigation	32	135	167
37	small room	Office	College of Alameda	A	3	4.1	Meets target with mitigation	17	64	38
38	A230	Office	College of Alameda	A	3	8.6	Meets target	0	64	0
39	A232	Computer Lab	College of Alameda	A	4	5.5	Meets target	0	654	120
40	A231	Classroom	College of Alameda	A	6	12.5	Meets target	0	642	120
41	A205	Computer Lab	College of Alameda	A	3	6.1	Meets target	0	348	120
42	A213	Classroom	College of Alameda	A	3	8.9	Meets target	0	463	120
43	A211	Classroom	College of Alameda	A	3	7.5	Meets target	0	161	120
44	A222	Science Lab	College of Alameda	A	3	3.8	Meets target	0	526	120
45	A209	Science Lab	College of Alameda	A	4	7.4	Meets target	0	68	0
46	A223	Science Lab	College of Alameda	A	4	4.2	Meets target	0	96	0
47	A220	Science Lab	College of Alameda	A	3	6.1	Meets target with mitigation	51	125	167
48	A219	Reception Areas	College of Alameda	A	3	3.2	Meets target with mitigation	158	193	167
49	A219 Office	Office	College of Alameda	A	3	7.3	Meets target with mitigation	50	90	167
50	A206	Locker Room	College of Alameda	A	3	8.4	Meets target with mitigation	60	66	167
51	A224	Classroom	College of Alameda	A	4	5.6	Meets target with mitigation	134	415	287
52	A204	Office	College of Alameda	A	3	6.5	Meets target with mitigation	45	115	167
53	A202	Classroom	College of Alameda	A	5	6.8	Meets target	0	457	120
54	A201A	Office	College of Alameda	A	3	4.7	Meets target	0	74	0
55	A200	Classroom	College of Alameda	A	4	7.0	Meets target	0	402	120