




Ventilation Assessment Summary

Ventilation Assessment

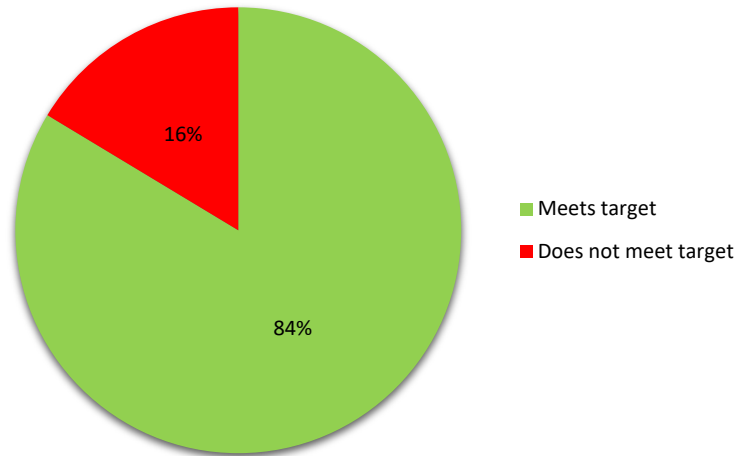

| # | HVAC | | Site | | Air Changes | | | | Halo |
|----|----------------------------|-----------|--------------------|----------|-------------|--------|----------------------|-----------|---------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm |
| 1 | A136 | Office | College of Alameda | A | 5 | 60.6 | Meets target | cfm | |
| 2 | A135 | Office | College of Alameda | A | 3 | 34.8 | Meets target | cfm | |
| 3 | A134 | Office | College of Alameda | A | 3 | 36.3 | Meets target | cfm | |
| 4 | A133 | Office | College of Alameda | A | 3 | 41.5 | Meets target | cfm | |
| 5 | A132 | Office | College of Alameda | A | 3 | 7.1 | Meets target | cfm | |
| 6 | A131 | Classroom | College of Alameda | A | 3 | 12.0 | Meets target | cfm | |
| 7 | A130 | Office | College of Alameda | A | 3 | 14.9 | Meets target | cfm | |
| 8 | A129 | Office | College of Alameda | A | 3 | 14.9 | Meets target | cfm | |
| 9 | A113 | Office | College of Alameda | A | 3 | 23.0 | Meets target | cfm | |
| 10 | A113 | Office | College of Alameda | A | 3 | 6.6 | Meets target | cfm | |
| 11 | A109 | Office | College of Alameda | A | 3 | 10.1 | Meets target | cfm | |
| 12 | A128 | Office | College of Alameda | A | 3 | 11.9 | Meets target | cfm | |
| 13 | A105 | Office | College of Alameda | A | 3 | 0.0 | Does not meet target | cfm | 2 |
| 14 | A103 | Office | College of Alameda | A | 3 | 10.9 | Meets target | cfm | |
| 15 | A102 | Office | College of Alameda | A | 3 | 20.5 | Meets target | cfm | |
| 16 | ng Lobby 1 | Lobby | College of Alameda | A | 3 | 9.5 | Meets target | cfm | |
| 17 | A108 | Office | College of Alameda | A | 3 | 10.2 | Meets target | cfm | |
| 18 | A107 | Office | College of Alameda | A | 3 | 11.5 | Meets target | cfm | |

| # | HVAC | | Site | | Air Changes | | | | Halo |
|----|-----------------------------|-----------------|--------------------|----------|-------------|--------|----------------------|-----------|---------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm |
| 19 | A115 | Office | College of Alameda | A | 3 | 2.2 | Does not meet target | cfm | 1 |
| 20 | A104A | Office | College of Alameda | A | 3 | 7.9 | Meets target | cfm | |
| 21 | A151 | Office | College of Alameda | A | 3 | 9.7 | Meets target | cfm | |
| 22 | A149 | Conference | College of Alameda | A | 3 | 8.2 | Meets target | cfm | |
| 23 | A147 | Office | College of Alameda | A | 3 | 13.1 | Meets target | cfm | |
| 24 | A146 | Office | College of Alameda | A | 3 | 13.4 | Meets target | cfm | |
| 25 | A145 | Office | College of Alameda | A | 3 | 11.9 | Meets target | cfm | |
| 26 | A144 | Conference | College of Alameda | A | 3 | 10.1 | Meets target | cfm | |
| 27 | A143 | Office | College of Alameda | A | 3 | 8.7 | Meets target | cfm | |
| 28 | A141 | Office | College of Alameda | A | 3 | 5.8 | Meets target | cfm | |
| 29 | A138 | Office | College of Alameda | A | 3 | 7.8 | Meets target | cfm | |
| 30 | A148 | Office | College of Alameda | A | 3 | 11.6 | Meets target | cfm | |
| 31 | O/A152/A | Office | College of Alameda | A | 3 | 6.2 | Meets target | cfm | |
| 32 | A226 | Break room | College of Alameda | A | 3 | 7.0 | Meets target | cfm | |
| 33 | A227 | Office | College of Alameda | A | 3 | 5.4 | Meets target | cfm | |
| 34 | A228 | Computer Lab | College of Alameda | A | 3 | 5.3 | Meets target | cfm | |
| 35 | A225 | Computer Lab | College of Alameda | A | 3 | 5.0 | Meets target | cfm | |
| 36 | A129A | Lobby | College of Alameda | A | 3 | 2.2 | Does not meet target | cfm | 1 |
| 37 | mall room | Office | College of Alameda | A | 3 | 4.1 | Meets target | cfm | |
| 38 | A230 | Office | College of Alameda | A | 3 | 8.6 | Meets target | cfm | |
| 39 | A232 | Computer Lab | College of Alameda | A | 4 | 5.5 | Meets target | cfm | |
| 40 | A231 | Classroom | College of Alameda | A | 6 | 12.5 | Meets target | cfm | |
| 41 | A205 | Computer Lab | College of Alameda | A | 3 | 6.1 | Meets target | cfm | |
| 42 | A213 | Classroom | College of Alameda | A | 3 | 8.9 | Meets target | cfm | |
| 43 | A211 | Classroom | College of Alameda | A | 3 | 7.5 | Meets target | cfm | |
| 44 | A222 | Science Lab | College of Alameda | A | 3 | 3.8 | Meets target | cfm | |
| 45 | A209 | Science Lab | College of Alameda | A | 4 | 7.4 | Meets target | cfm | |
| 46 | A223 | Science Lab | College of Alameda | A | 4 | 4.2 | Meets target | cfm | |
| 47 | A220 | Science Lab | College of Alameda | A | 3 | 1.6 | Does not meet target | cfm | 1 |
| 48 | A219 | Reception Areas | College of Alameda | A | 3 | 0.3 | Does not meet target | cfm | 2 |
| 49 | A219 Office | Office | College of Alameda | A | 3 | 1.2 | Does not meet target | cfm | 1 |
| 50 | A206 | Locker Room | College of Alameda | A | 3 | 0.0 | Does not meet target | cfm | 1 |
| 51 | A224 | Classroom | College of Alameda | A | 4 | 3.8 | Does not meet target | cfm | 2 |
| 52 | A204 | Office | College of Alameda | A | 3 | 1.7 | Does not meet target | cfm | 1 |

| # | HVAC | | Site | | Air Changes | | | | Halo |
|----|-----------------------|-----------|--------------------|----------|-------------|--------|--------------|-----------|---------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm |
| 53 | A202 | Classroom | College of Alameda | A | 5 | 6.8 | Meets target | cfm | |
| 54 | A201A | Office | College of Alameda | A | 3 | 4.7 | Meets target | cfm | |
| 55 | A200 | Classroom | College of Alameda | A | 4 | 7.0 | Meets target | cfm | |