




## Ventilation Assessment Summary

### Ventilation Assessment

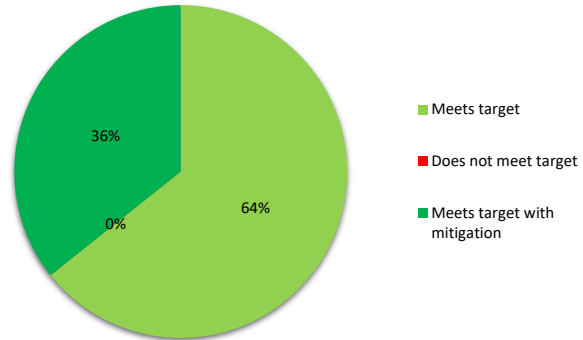

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<a href="#">B108</a>	Office	College of Alameda	B	3	10.2	Meets target	0	53	0
2	<a href="#">B109</a>	Office	College of Alameda	B	3	8.1	Meets target	0	59	0
3	<a href="#">B114A</a>	Office	College of Alameda	B	3	5.9	Meets target with mitigation	35	150	167
4	<a href="#">B114</a>	Classroom	College of Alameda	B	3	3.6	Meets target	0	660	0
5	<a href="#">B111</a>	Classroom	College of Alameda	B	3	3.4	Meets target with mitigation	86	681	167
6	<a href="#">B106</a>	Classroom	College of Alameda	B	4	4.4	Meets target with mitigation	363	400	399
7	<a href="#">B112</a>	Office	College of Alameda	B	3	11.0	Meets target	0	59	0
8	<a href="#">B113</a>	Occupiable Storage (C	College of Alameda	B	3	8.6	Meets target with mitigation	59	64	167
9	<a href="#">B201</a>	Classroom	College of Alameda	B	3	11.6	Meets target	0	405	240
10	<a href="#">B202</a>	Classroom	College of Alameda	B	4	10.5	Meets target	0	536	240
11	<a href="#">B203</a>	Classroom	College of Alameda	B	4	8.0	Meets target	0	539	240
12	<a href="#">B2 Automotive Storage</a>	Occupiable Storage (C	College of Alameda	B	3	13.2	Meets target	0	57	0
13	<a href="#">B2 Storage</a>	Occupiable Storage (C	College of Alameda	B	3	5.0	Meets target	0	121	0
14	<a href="#">B105</a>	Classroom	College of Alameda	B	3	3.6	Meets target with mitigation	468	515	566