




Ventilation Assessment Summary

Ventilation Assessment

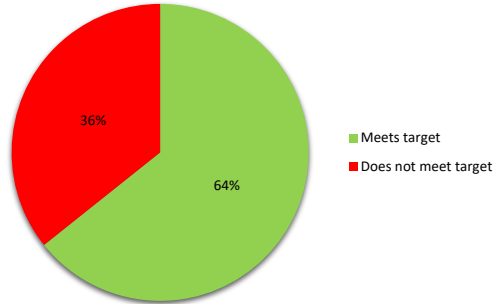

#	HVAC		Site		Air Changes				Halo Air Purifier	OR	PAC	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	120 cfm		100 cfm	300 cfm
1	B108	Office	College of Alameda	B	3	10.2	Meets target	cfm				
2	B109	Office	College of Alameda	B	3	8.1	Meets target	cfm				
3	B114A	Office	College of Alameda	B	3	2.2	Does not meet target	cfm	1		1	
4	B114	Classroom	College of Alameda	B	3	3.6	Meets target	cfm				
5	B111	Classroom	College of Alameda	B	3	2.6	Does not meet target	cfm	1		1	
6	B106	Classroom	College of Alameda	B	4	0.0	Does not meet target	cfm	3		1	
7	B112	Office	College of Alameda	B	3	11.0	Meets target	cfm				
8	B113	Occupiable Storage (I	College of Alameda	B	3	0.0	Does not meet target	cfm	1		1	
9	B201	Classroom	College of Alameda	B	3	9.7	Meets target	cfm				
10	B202	Classroom	College of Alameda	B	4	8.5	Meets target	cfm				
11	B203	Classroom	College of Alameda	B	4	6.0	Meets target	cfm				
12	B2 Automotive Storage	Occupiable Storage (I	College of Alameda	B	3	13.2	Meets target	cfm				
13	B2 Storage	Occupiable Storage (I	College of Alameda	B	3	5.0	Meets target	cfm				
14	B105	Classroom	College of Alameda	B	3	0.0	Does not meet target	cfm	4		2	