


Ventilation Assessment Summary

Ventilation Assessment

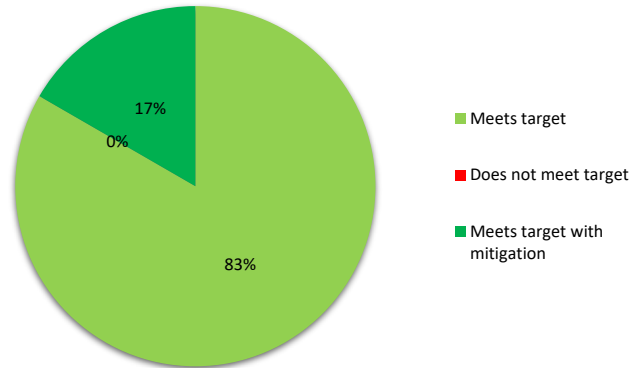

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	C213	Classroom	College of Alameda	C	4	4.0	Meets target	0	486	0
2	C212	Classroom	College of Alameda	C	3	12.3	Meets target	0	516	0
3	C211	Classroom	College of Alameda	C	5	15.1	Meets target	0	800	0
4	C210	Classroom	College of Alameda	C	3	12.5	Meets target	0	528	0
5	C209	Classroom	College of Alameda	C	4	18.7	Meets target	0	696	0
6	C208	Classroom	College of Alameda	C	4	18.7	Meets target	0	696	0
7	C204	Lobby	College of Alameda	C	3	27.9	Meets target	0	101	0
8	C205	Office	College of Alameda	C	3	9.3	Meets target	0	45	0
9	C206	Office	College of Alameda	C	3	13.5	Meets target	0	48	0
10	C207	Office	College of Alameda	C	3	18.9	Meets target	0	102	0
10	C203	Office	College of Alameda	C	3	21.9	Meets target	0	48	0
11	C202	Office	College of Alameda	C	3	19.1	Meets target	0	52	0
12	C113	Classroom	College of Alameda	C	3	16.3	Meets target	0	582	0
13	C201	Office	College of Alameda	C	3	16.2	Meets target	0	58	0
14	C113A	Office	College of Alameda	C	3	15.3	Meets target	0	48	0
15	C104	Classroom	College of Alameda	C	3	3.2	Meets target with mitigation	220	813	279
16	C103	Break room	College of Alameda	C	3	4.1	Meets target	0	355	0
17	C105	Classroom	College of Alameda	C	4	10.1	Meets target	0	754	0
18	C106	Office	College of Alameda	C	3	25.6	Meets target	0	89	0
19	C107	Office	College of Alameda	C	3	8.3	Meets target with mitigation	41	79	167
20	C109	Classroom	College of Alameda	C	3	9.1	Meets target	0	562	0
21	C110	Office	College of Alameda	C	3	16.1	Meets target	0	87	0
22	C112	Classroom	College of Alameda	C	3	3.3	Meets target with mitigation	82	859	167
23	C111	Science Lab	College of Alameda	C	3	4.2	Meets target with mitigation	118	130	167