




Ventilation Assessment Summary

Ventilation Assessment

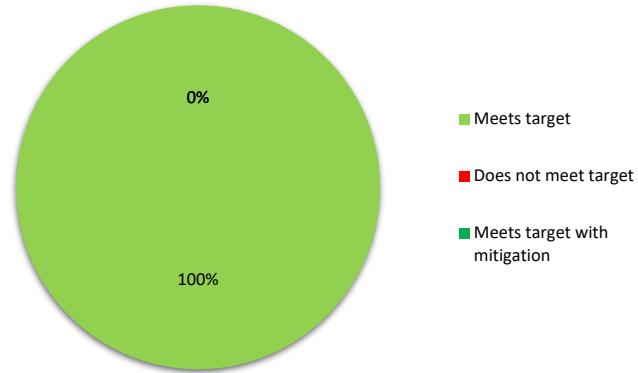

#	HVAC		Site		Air Changes			Reccomendations		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	P101	Office	College of Alameda	P	3	10.6	Meets target	0	121	0
2	P102	Office	College of Alameda	P	3	11.3	Meets target	0	260	0
3	P102A	Office	College of Alameda	P	3	13.1	Meets target	0	59	0
4	P102B	Office	College of Alameda	P	3	11.6	Meets target	0	63	0
5	P103	Office	College of Alameda	P	3	16.4	Meets target	0	129	0