




## Ventilation Assessment Summary

### Ventilation Assessment

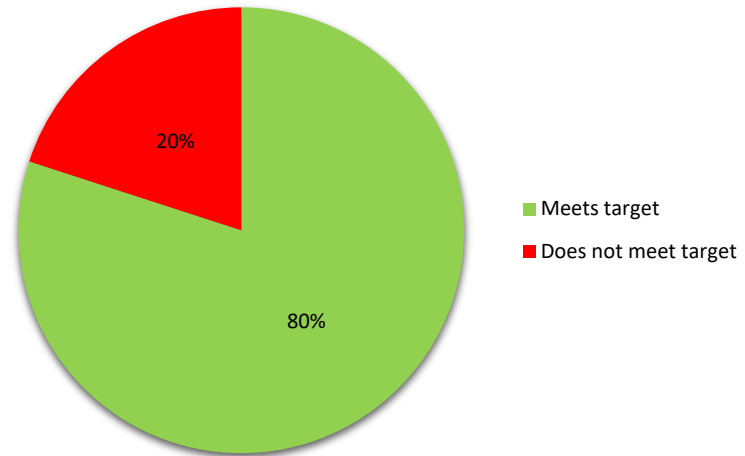

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	100 cfm
1	<a href="#">CC5</a>	Office	College of Alameda	Child Care	3	7.8	Meets target	cfm	
2	<a href="#">CC5A</a>	Occupiable Storage (D	College of Alameda	Child Care	3	0.0	Does not meet target	cfm	1
3	<a href="#">CC6</a>	Break room	College of Alameda	Child Care	3	9.8	Meets target	cfm	
4	<a href="#">CC17</a>	Classroom (<4)	College of Alameda	Child Care	3	7.1	Meets target	cfm	
5	<a href="#">CC20</a>	Classroom (<4)	College of Alameda	Child Care	3	6.6	Meets target	cfm	