




Ventilation Assessment Summary

Ventilation Assessment

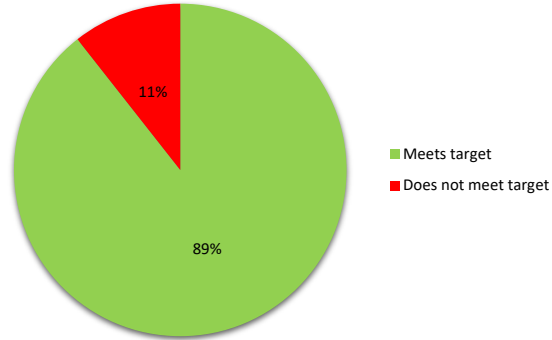

#	HVAC		Site		Air Changes				Halo Air Purifier		PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	120 CFM		100 CFM
1	D208	Classroom	College of Alameda	D	4	6.6	Meets target	cfm			
2	D204	Classroom	College of Alameda	D	3	14.8	Meets target	cfm			
3	D229	Classroom	College of Alameda	D	3	16.4	Meets target	cfm			
4	D240-241 Forum	Auditorium Seating	College of Alameda	D				cfm			
5	D234	Office	College of Alameda	D	3	5.6	Meets target	cfm			
6	D233	Office	College of Alameda	D	3	7.4	Meets target	cfm			
7	D107	Office	College of Alameda	D	3	5.5	Meets target	cfm			
8	D109	Wood/Metal Shop	College of Alameda	D	3	34.3	Meets target	cfm			
9	D108	Occupiable Storage (Dry)	College of Alameda	D	3	9.9	Meets target	cfm			
10	D110	Occupiable Storage (Dry)	College of Alameda	D	3	27.4	Meets target	cfm			
11	D105	Science Lab	College of Alameda	D	3	28.4	Meets target	cfm			
12	D114	Office	College of Alameda	D	3	11.2	Meets target	cfm			
13	D115A	Occupiable Storage (Dry)	College of Alameda	D	3	9.1	Meets target	cfm			
14	D114C	Office	College of Alameda	D	3	19.7	Meets target	cfm			
15	D115	Science Lab	College of Alameda	D	3	9.9	Meets target	cfm			
16	D116	Computer Lab	College of Alameda	D	3	7.6	Meets target	cfm			
17	D115B	Office	College of Alameda	D	3	11.8	Meets target	cfm			
18	D117A	Office	College of Alameda	D	3	0.0	Does not meet target	cfm	1	OR	1
19	D117	Office	College of Alameda	D	3	13.6	Meets target	cfm			
20	D117B	Office	College of Alameda	D	3	7.9	Meets target	cfm			
21	D117D	Office	College of Alameda	D	3	13.2	Meets target	cfm			
22	D117C	Office	College of Alameda	D	3	7.7	Meets target	cfm			
23	D117E	Office	College of Alameda	D	3	12.5	Meets target	cfm			
24	D117G	Office	College of Alameda	D	3	9.7	Meets target	cfm			
25	D117F	Office	College of Alameda	D	3	5.3	Meets target	cfm			
26	D124	Office	College of Alameda	D	3	4.8	Meets target	cfm			
27	D118	Office	College of Alameda	D	3	4.7	Meets target	cfm			
28	D122	Break room	College of Alameda	D	3	4.9	Meets target	cfm			
29	D119	Lecture Room	College of Alameda	D	3	8.6	Meets target	cfm			
30	D202 AND D203	Office	College of Alameda	D	3	14.8	Meets target	cfm			
31	D202C	Office	College of Alameda	D	3	37.4	Meets target	cfm			

#	HVAC		Site		Air Changes				Halo Air Purifier	PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	120 CFM	100 CFM
32	D202D	Office	College of Alameda	D	3	23.2	Meets target	cfm		
33	D205	Classroom	College of Alameda	D	3	14.2	Meets target	cfm		
34	D202B	Conference	College of Alameda	D	3	32.2	Meets target	cfm		
35	D202A	Office	College of Alameda	D	3	17.5	Meets target	cfm		
36	D215	Occupiable Storage (Dry)	College of Alameda	D	3	4.9	Meets target	cfm		
37	D216	Office	College of Alameda	D	3	34.6	Meets target	cfm		
38	D217	Office	College of Alameda	D	3	34.4	Meets target	cfm		
39	D218	OFFICE	College of Alameda	D	3	13.0	Meets target	cfm		
40	D219	Office	College of Alameda	D	3	11.4	Meets target	cfm		
41	D207	Classroom	College of Alameda	D	3	6.4	Meets target	cfm		
42	D206	Office	College of Alameda	D				cfm		
43	D222	Classroom	College of Alameda	D	4	12.8	Meets target	cfm		
44	D227	Lobby	College of Alameda	D	3	3.7	Meets target	cfm		
45	D225	Office	College of Alameda	D	3	11.7	Meets target	cfm		
46	D226	Office	College of Alameda	D	3	12.7	Meets target	cfm		
47	D224	Office	College of Alameda	D	3	6.9	Meets target	cfm		
48	D227A	Office	College of Alameda	D	3	0.0	Does not meet target	cfm	1	1
49	D228	Conference	College of Alameda	D	3	8.9	Meets target	cfm		
50	D230	Lecture Room	College of Alameda	D	3	2.0	Does not meet target	cfm	1	1
51	D232	Occupiable Storage (Dry)	College of Alameda	D	3	0.0	Does not meet target	cfm	1	1

#	HVAC		Site		Air Changes				Halo Air Purifier	PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	120 CFM	100 CFM
52	D232A	Office	College of Alameda	D	3	12.5	Meets target	cfm		
53	D302	Classroom	College of Alameda	D	3	4.1	Meets target	cfm		
54	D307	Classroom	College of Alameda	D	3	4.4	Meets target	cfm		
55	D306	Office	College of Alameda	D	3	8.4	Meets target	cfm		
56	D310	Classroom	College of Alameda	D	3	5.1	Meets target	cfm		
57	D314	Lecture Room	College of Alameda	D	3	5.7	Meets target	cfm		
58	D315	Classroom	College of Alameda	D	3	4.9	Meets target	cfm		
59	D315 Office	Office	College of Alameda	D	3	10.4	Meets target	cfm		
60	D320	Office	College of Alameda	D	3	14.9	Meets target	cfm		
61	D317	Occupiable Storage (Dry)	College of Alameda	D	3	7.5	Meets target	cfm		
62	D318	Occupiable Storage (Dry)	College of Alameda	D	3	8.9	Meets target	cfm		
63	D103	Wood/Metal Shop	College of Alameda	D	3	11.1	Meets target	cfm		
64	CLEAN ROOM	Wood/Metal Shop	College of Alameda	D	3	3.7	Meets target	cfm		
65	D104	Wood/Metal Shop	College of Alameda	D	3	0.0	Does not meet target	cfm	2	2
66	D103A	Wood/Metal Shop	College of Alameda	D	3	0.0	Does not meet target	cfm	1	1
67	D114B	Occupiable Storage (Dry)	College of Alameda	D	3	9.8	Meets target	cfm		
68	D236	Occupiable Storage (Dry)	College of Alameda	D	3	0.0	Does not meet target	cfm	2	2