


Ventilation Assessment Summary

Ventilation Assessment

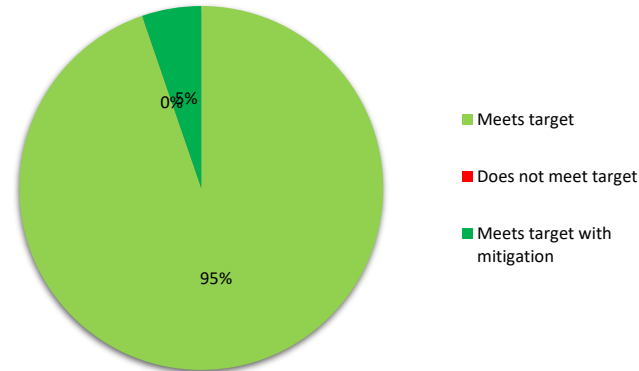

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	G118A	Music	College of Alameda	G + Gym	4	4.2	Meets target with mitigation	103	361	120
2	G116A	Office	College of Alameda	G + Gym	3	5.2	Meets target	0	41	0
3	G119	Music	College of Alameda	G + Gym	3	9.3	Meets target	0	578	120
4	G129	Office	College of Alameda	G + Gym	3	6.8	Meets target	0	123	0
5	G130	Office	College of Alameda	G + Gym	3	3.3	Meets target	0	87	0
6	G132	Locker Room	College of Alameda	G + Gym	3	5.0	Meets target	0	90	0
7	G124	Locker Room	College of Alameda	G + Gym	3	6.4	Meets target	0	855	830
8	G127	Laundry Room	College of Alameda	G + Gym	3	27.0	Meets target	0	69	0
9	G124B	Locker Room	College of Alameda	G + Gym	3	6.6	Meets target	0	204	120
10	G124A	Office	College of Alameda	G + Gym	3	26.8	Meets target	0	100	710
11	G214	Weight Room	College of Alameda	G + Gym	3	5.3	Meets target	0	1446	830
12	G214A	Office	College of Alameda	G + Gym	3	3.3	Meets target	0	85	0
13	G234	Office	College of Alameda	G + Gym	3	11.9	Meets target	0	40	0
14	G233	Office	College of Alameda	G + Gym	3	11.5	Meets target	0	37	0
15	G231	Computer	College of Alameda	G + Gym	3	16.7	Meets target	0	370	240
16	G235	Office	College of Alameda	G + Gym	3	14.0	Meets target	0	44	0
17	G232	Office	College of Alameda	G + Gym	3	18.9	Meets target	0	40	0
18	G229	Locker Room	College of Alameda	G + Gym	3	6.9	Meets target	0	44	0
19	G222	Office	College of Alameda	G + Gym	3	4.3	Meets target	0	574	0