




Ventilation Assessment Summary

Ventilation Assessment

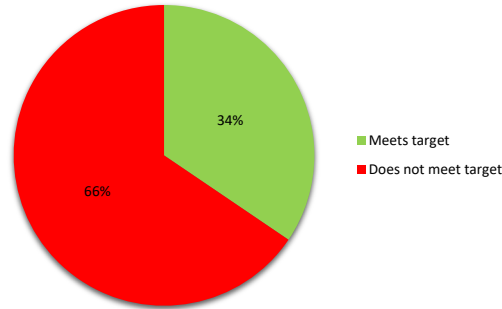

| # | HVAC | | Site | | Air Changes | | | | Halo | OR | PAC | | BSE-A-800 | BSE-A-1000 |
|----|---------------------|-----------------------|--------------------|----------|-------------|--------|----------------------|-----------|---------|----|---------|---------|-----------|------------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm | | 100 cfm | 300 cfm | 710 cfm | 1065 cfm |
| 1 | 154 | Classroom | College of Alameda | H | 3 | 2.4 | Does not meet target | 148 | 2 | | | | | |
| 2 | 153 | Classroom | College of Alameda | H | 3 | 2.3 | Does not meet target | 174 | 2 | | | 1 | | |
| 3 | 152 | Classroom | College of Alameda | H | 3 | 2.4 | Does not meet target | 166 | 2 | | | 1 | | |
| 4 | 151 | Classroom | College of Alameda | H | 3 | 2.3 | Does not meet target | 186 | 2 | | | 1 | | |
| 5 | 102 | Classroom | College of Alameda | H | 3 | 3.6 | Meets target | 0 | | | | | | |
| 6 | 122 | Occupiable Storage (t | College of Alameda | H | 3 | 3.9 | Meets target | 0 | | | | | | |
| 7 | 123 | Office | College of Alameda | H | 3 | 5.4 | Meets target | 0 | | | | | | |
| 8 | 113 | Classroom | College of Alameda | H | 3 | 2.7 | Does not meet target | 88 | 1 | | 1 | | | |
| 9 | 112 | Classroom | College of Alameda | H | 3 | 4.8 | Meets target | 0 | | | | | | |
| 10 | 109 | Classroom | College of Alameda | H | 4 | 4.5 | Meets target | 0 | | | | | | |
| 11 | 108 | Computer Lab | College of Alameda | H | 3 | 4.3 | Meets target | 0 | | | | | | |
| 12 | 107 | Kitchen | College of Alameda | H | 3 | 3.7 | Meets target | 0 | | | | | | |
| 13 | 220 | Office | College of Alameda | H | 3 | 16.0 | Meets target | 0 | | | | | | |
| 14 | 202 | Classroom | College of Alameda | H | 3 | 3.7 | Meets target | 0 | | | | | | |
| 15 | 222 | Office | College of Alameda | H | 3 | 4.6 | Meets target | 0 | | | | | | |
| 16 | 213 | Classroom | College of Alameda | H | 3 | 3.7 | Meets target | 0 | | | | | | |
| 17 | 207 | Office | College of Alameda | H | 3 | 4.9 | Meets target | 0 | | | | | | |
| 18 | 212 | Classroom | College of Alameda | H | 3 | 0.0 | Does not meet target | 750 | 7 | | | | | |
| 19 | 208 | Classroom | College of Alameda | H | 3 | 2.5 | Does not meet target | 210 | 2 | | 1 | | 1 | |
| 20 | 209 | Office | College of Alameda | H | 3 | 7.4 | Meets target | 0 | | | | | | |
| 21 | 206 | Occupiable Storage (t | College of Alameda | H | 3 | 1.7 | Does not meet target | 206 | 2 | | | 1 | | |
| 22 | 203 | Lobby | College of Alameda | H | 3 | 2.7 | Does not meet target | 17 | 1 | | 1 | | | |
| 23 | 204 | Conference | College of Alameda | H | 3 | 1.4 | Does not meet target | 140 | 2 | | | 1 | | |
| 24 | 264 | Office | College of Alameda | H | 3 | 2.1 | Does not meet target | 29 | 1 | | 1 | | | |
| 25 | 263 | Office | College of Alameda | H | 3 | 1.6 | Does not meet target | 29 | 1 | | 1 | | | |
| 26 | 262 | Office | College of Alameda | H | 3 | 2.1 | Does not meet target | 29 | 1 | | 1 | | | |
| 27 | 261 | Office | College of Alameda | H | 3 | 2.5 | Does not meet target | 9 | 1 | | 1 | | | |
| 28 | 260 | Office | College of Alameda | H | 3 | 2.6 | Does not meet target | 6 | 1 | | 1 | | | |
| 29 | 259 | Office | College of Alameda | H | 3 | 1.5 | Does not meet target | 27 | 1 | | 1 | | | |
| 30 | 258 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 51 | 1 | | 1 | | | |
| 31 | 257 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 51 | 1 | | 1 | | | |
| 32 | 254 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 51 | 1 | | 1 | | | |
| 33 | 253 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 52 | 1 | | 1 | | | |
| 34 | 255 | Office | College of Alameda | H | 3 | 1.2 | Does not meet target | 32 | 1 | | 1 | | | |
| 35 | 256 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 52 | 1 | | 1 | | | |
| 36 | 252 | Office | College of Alameda | H | 3 | 5.1 | Meets target | 5 | 1 | | 1 | | | |

| # | HVAC | | Site | | Air Changes | | | | Halo | OR | PAC | | BSE-A-800 | BSE-A-1000 |
|----|----------------------------|-----------------------|--------------------|----------|-------------|--------|----------------------|-----------|---------|----|---------|---------|-----------|------------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm | | 100 cfm | 300 cfm | 710 cfm | 1065 cfm |
| 37 | 278.Lounge | Break room | College of Alameda | H | 3 | 1.7 | Does not meet target | 62 | 1 | | 1 | | | |
| 38 | 251 | Office | College of Alameda | H | 3 | 2.1 | Does not meet target | 65 | 1 | | 1 | | | |
| 39 | 274 | Office | College of Alameda | H | 3 | 2.0 | Does not meet target | 20 | 1 | | 1 | | | |
| 40 | 273 | Office | College of Alameda | H | 3 | 0.0 | Does not meet target | 59 | 1 | | 1 | | | |
| 41 | 279 | Conference | College of Alameda | H | 3 | 2.3 | Does not meet target | 8 | 1 | | 1 | | | |
| 42 | 272 | Office | College of Alameda | H | 3 | 2.3 | Does not meet target | 15 | 1 | | 1 | | | |
| 43 | 271 | Office | College of Alameda | H | 3 | 1.0 | Does not meet target | 38 | 1 | | 1 | | | |
| 44 | 270 | Office | College of Alameda | H | 3 | 1.0 | Does not meet target | 39 | 1 | | 1 | | | |
| 45 | 280 | Conference | College of Alameda | H | 3 | 2.2 | Does not meet target | 51 | 1 | | 1 | | | |
| 46 | 281 | Conference | College of Alameda | H | 3 | 1.7 | Does not meet target | 40 | 1 | | 1 | | | |
| 47 | 269 | Office | College of Alameda | H | 3 | 2.0 | Does not meet target | 21 | 1 | | 1 | | | |
| 48 | 283 | Occupiable Storage (I | College of Alameda | H | 3 | 0.9 | Does not meet target | 106 | 1 | | 1 | | | |
| 49 | 268 | Office | College of Alameda | H | 3 | 1.5 | Does not meet target | 31 | 1 | | 1 | | | |
| 50 | 267 | Office | College of Alameda | H | 3 | 26.8 | Meets target | 0 | | | | | | |
| 51 | 312 | Classroom | College of Alameda | H | 3 | 4.6 | Meets target | 0 | | | | | | |

| # | HVAC | | Site | | Air Changes | | | | Halo | OR | PAC | | BSE-A-800 | BSE-A-1000 |
|----|---------------------|-----------------------|--------------------|----------|-------------|--------|----------------------|-----------|---------|----|---------|---------|-----------|------------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm | | 100 cfm | 300 cfm | 710 cfm | 1065 cfm |
| 52 | 313 | Classroom | College of Alameda | H | 3 | 4.5 | Meets target | 0 | | | | | | |
| 53 | 320 | Office | College of Alameda | H | 3 | 10.7 | Meets target | 0 | | | | | | |
| 54 | 322 | Computer Lab | College of Alameda | H | 3 | 4.5 | Meets target | 0 | | | | | | |
| 55 | 303 | Occupiable Storage (t | College of Alameda | H | 3 | 2.6 | Does not meet target | 32 | 1 | | 1 | | | |
| 56 | 302 | Classroom | College of Alameda | H | 3 | 1.2 | Does not meet target | 733 | | | | | 1 | |
| 57 | 305 | Classroom | College of Alameda | H | 3 | 2.5 | Does not meet target | 291 | 3 | | 1 | | | |
| 58 | 308 | Classroom | College of Alameda | H | 3 | 4.0 | Meets target | 0 | | | | | | |