




Ventilation Assessment Summary

Ventilation Assessment

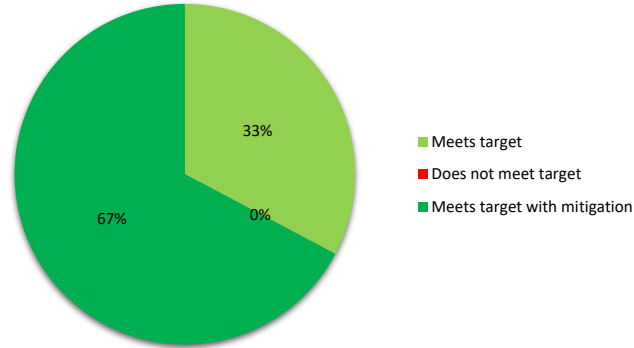

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	154	Classroom	College of Alameda	H	3	3.5	Meets target with mitigation	148	857	287
2	153	Classroom	College of Alameda	H	3	3.4	Meets target with mitigation	174	852	287
3	152	Classroom	College of Alameda	H	3	3.5	Meets target with mitigation	166	844	287
4	151	Classroom	College of Alameda	H	3	3.4	Meets target with mitigation	186	861	287
5	102	Classroom	College of Alameda	H	3	4.2	Meets target	0	627	120
6	122	Occupiable Storage (I	College of Alameda	H	3	3.9	Meets target	0	521	0
7	123	Office	College of Alameda	H	3	5.4	Meets target	0	123	0
8	113	Classroom	College of Alameda	H	3	3.1	Meets target with mitigation	88	841	120
9	112	Classroom	College of Alameda	H	3	5.2	Meets target	0	830	120
10	109	Classroom	College of Alameda	H	4	4.9	Meets target	0	1132	120
11	108	Computer Lab	College of Alameda	H	3	4.8	Meets target	0	764	120
12	107	Kitchen	College of Alameda	H	3	3.7	Meets target	0	105	0
13	220	Office	College of Alameda	H	3	16.0	Meets target	0	86	0
14	202	Classroom	College of Alameda	H	3	4.5	Meets target	0	555	120
15	222	Office	College of Alameda	H	3	5.3	Meets target	0	594	120
16	213	Classroom	College of Alameda	H	3	4.1	Meets target	0	840	120
17	207	Office	College of Alameda	H	3	4.9	Meets target	0	108	0
18	212	Classroom	College of Alameda	H	3	3.0	Meets target with mitigation	118	825	120
19	208	Classroom	College of Alameda	H	3	4.2	Meets target with mitigation	210	1405	710
20	209	Office	College of Alameda	H	3	7.4	Meets target	0	58	0
21	206	Occupiable Storage (I	College of Alameda	H	3	3.4	Meets target with mitigation	206	535	279
22	203	Lobby	College of Alameda	H	3	6.0	Meets target with mitigation	17	167	167
23	204	Conference	College of Alameda	H	3	3.3	Meets target with mitigation	140	289	167
24	264	Office	College of Alameda	H	3	7.1	Meets target with mitigation	29	110	167
25	263	Office	College of Alameda	H	3	9.8	Meets target with mitigation	29	67	167
26	262	Office	College of Alameda	H	3	7.1	Meets target with mitigation	29	110	167
27	261	Office	College of Alameda	H	3	11.6	Meets target with mitigation	9	60	167
28	260	Office	College of Alameda	H	3	12.5	Meets target with mitigation	6	56	167
29	259	Office	College of Alameda	H	3	11.0	Meets target with mitigation	27	58	167

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
30	258	Office	College of Alameda	H	3	9.8	Meets target with mitigation	51	56	167
31	257	Office	College of Alameda	H	3	9.8	Meets target with mitigation	51	56	167
32	254	Office	College of Alameda	H	3	9.8	Meets target with mitigation	51	56	167
33	253	Office	College of Alameda	H	3	9.7	Meets target with mitigation	52	57	167
34	255	Office	College of Alameda	H	3	10.8	Meets target with mitigation	32	57	167
35	256	Office	College of Alameda	H	3	9.7	Meets target with mitigation	52	57	167
36	252	Office	College of Alameda	H	3	5.1	Meets target with mitigation	5	53	38
37	278.Lounge	Break room	College of Alameda	H	3	5.2	Meets target with mitigation	62	154	167
38	251	Office	College of Alameda	H	3	3.7	Meets target with mitigation	65	250	120
39	274	Office	College of Alameda	H	3	10.6	Meets target with mitigation	20	64	167
40	273	Office	College of Alameda	H	3	8.6	Meets target with mitigation	59	64	167
41	279	Conference	College of Alameda	H	3	16.8	Meets target with mitigation	8	38	167
42	272	Office	College of Alameda	H	3	10.8	Meets target with mitigation	15	64	167
43	271	Office	College of Alameda	H	3	9.7	Meets target with mitigation	38	64	167
44	270	Office	College of Alameda	H	3	9.6	Meets target with mitigation	39	64	167
45	280	Conference	College of Alameda	H	3	4.9	Meets target with mitigation	51	205	167
46	281	Conference	College of Alameda	H	3	7.1	Meets target with mitigation	40	103	167
47	269	Office	College of Alameda	H	3	10.5	Meets target with mitigation	21	65	167
48	283	Occupiable Storage (C	College of Alameda	H	3	4.2	Meets target with mitigation	106	166	167
49	268	Office	College of Alameda	H	3	9.8	Meets target with mitigation	31	66	167
50	267	Office	College of Alameda	H	3	26.8	Meets target	0	64	0
51	312	Classroom	College of Alameda	H	3	5.1	Meets target	0	830	120
52	313	Classroom	College of Alameda	H	3	4.9	Meets target	0	840	120
53	320	Office	College of Alameda	H	3	10.7	Meets target	0	91	0
54	322	Computer Lab	College of Alameda	H	3	5.2	Meets target	0	594	120
55	303	Occupiable Storage (C	College of Alameda	H	3	4.8	Meets target with mitigation	32	243	167
56	302	Classroom	College of Alameda	H	3	3.0	Meets target with mitigation	733	1320	710
57	305	Classroom	College of Alameda	H	3	4.0	Meets target with mitigation	291	1841	710
58	308	Classroom	College of Alameda	H	3	5.8	Meets target	0	1331	710