




## Ventilation Assessment Summary

### Ventilation Assessment

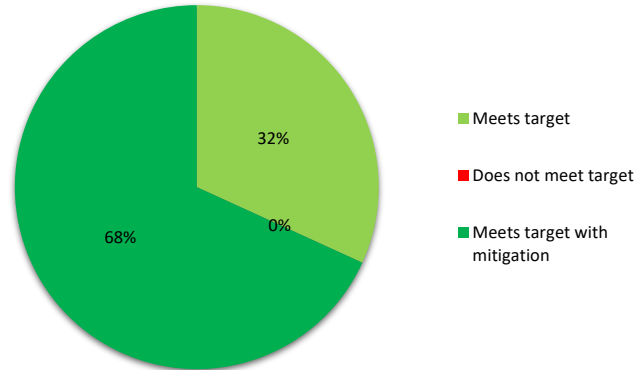

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<a href="#">L115</a>	Break room	College of Alameda	Library	3	4.9	Meets target with mitigation	102	112	167
2	<a href="#">L119</a>	Office	College of Alameda	Library	3	7.0	Meets target	0	197	0
3	<a href="#">L118</a>	Library	College of Alameda	Library	3	7.1	Meets target	0	1070	0
4	<a href="#">L121</a>	Office	College of Alameda	Library	3	5.3	Meets target with mitigation	94	104	167
5	<a href="#">L120</a>	Office	College of Alameda	Library	3	4.8	Meets target with mitigation	104	114	167
6	<a href="#">L106</a>	Office	College of Alameda	Library	3	5.0	Meets target with mitigation	101	111	167
7	<a href="#">L107</a>	Conference	College of Alameda	Library	3	9.4	Meets target with mitigation	53	59	167
8	<a href="#">L108</a>	Conference	College of Alameda	Library	3	9.2	Meets target with mitigation	55	60	167
9	<a href="#">L109</a>	Conference	College of Alameda	Library	3	5.1	Meets target with mitigation	98	108	167
10	<a href="#">10A &amp; L11</a>	Office	College of Alameda	Library	3	6.9	Meets target with mitigation	72	80	167
11	<a href="#">L231</a>	Reception Areas	College of Alameda	Library	3	3.7	Meets target	0	118	0
12	<a href="#">L235</a>	Office	College of Alameda	Library	3	15.5	Meets target	0	194	0
13	<a href="#">L236</a>	Office	College of Alameda	Library	3	14.3	Meets target	0	84	0
14	<a href="#">L226 (2/2)</a>	Conference	College of Alameda	Library	3	7.6	Meets target	0	308	0
15	<a href="#">L237</a>	Conference	College of Alameda	Library	3	7.9	Meets target with mitigation	0	604	120
16	<a href="#">L102</a>	Library	College of Alameda	Library	3	3.2	Meets target with mitigation	7165	29048	9360
17	<a href="#">L223</a>	Office	College of Alameda	Library	3	8.0	Meets target with mitigation	0	1254	120
18	<a href="#">L226 (1/2)</a>	Break room	College of Alameda	Library	3	10.9	Meets target	0	234	0
19	<a href="#">L227</a>	Office	College of Alameda	Library	3	9.6	Meets target with mitigation	52	58	167
20	<a href="#">L228</a>	Office	College of Alameda	Library	3	5.1	Meets target with mitigation	98	108	167
21	<a href="#">L229</a>	Office	College of Alameda	Library	3	9.2	Meets target with mitigation	55	60	167
22	<a href="#">L230</a>	Office	College of Alameda	Library	3	6.7	Meets target with mitigation	75	83	167