


Ventilation Assessment Summary

Ventilation Assessment

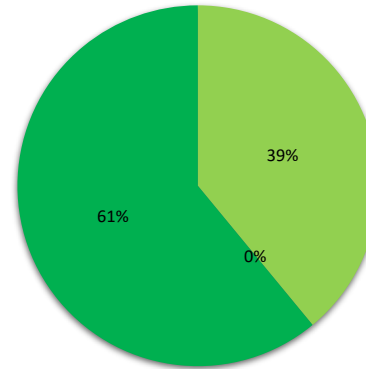

■ Meets target
■ Does not meet target
■ Meets target with mitigation

#	HVAC		Site		Air Changes			Reccommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	144	Science Lab	College of Alameda	Science Annex	3	7.5	Meets target with mitigation	67	74	167
2	143	Occupiable Storage (I	College of Alameda	Science Annex	3	3.1	Meets target with mitigation	162	178	167
3	141	Science Lab	College of Alameda	Science Annex	3	11.1	Meets target with mitigation	45	50	167
4	140	Classroom	College of Alameda	Science Annex	3	5.9	Meets target with mitigation	0	758	120
5	137	Occupiable Storage (I	College of Alameda	Science Annex	3	8.8	Meets target	0	80	0
6	136	Science Lab	College of Alameda	Science Annex	3	5.4	Meets target	0	240	0
7	135	Office	College of Alameda	Science Annex	3	5.0	Meets target	0	75	0
8	166	Occupiable Storage (I	College of Alameda	Science Annex	3	15.3	Meets target with mitigation	33	36	167
9	134	Classroom	College of Alameda	Science Annex	4	4.4	Meets target	0	851	0
10	133	Office	College of Alameda	Science Annex	3	5.8	Meets target	0	78	0
11	130	Science Lab	College of Alameda	Science Annex	4	6.1	Meets target with mitigation	0	977	120
12	127	Break room	College of Alameda	Science Annex	3	3.4	Meets target with mitigation	255	280	287
13	127	Multiuse Assembly	College of Alameda	Science Annex	3	3.4	Meets target with mitigation	149	163	167
14	124	Office	College of Alameda	Science Annex	3	4.5	Meets target with mitigation	186	204	279
15	120	Reception Areas	College of Alameda	Science Annex	3	4.4	Meets target with mitigation	189	208	279
16	123	Lecture Room	College of Alameda	Science Annex	3	4.4	Meets target with mitigation	115	127	167
17	122	Office	College of Alameda	Science Annex	3	3.4	Meets target with mitigation	147	162	167
18	180	Science Lab	College of Alameda	Science Annex	3	6.1	Meets target	0	311	0
19	187	Science Lab	College of Alameda	Science Annex	3	16.0	Meets target	0	107	0
20	186	Science Lab	College of Alameda	Science Annex	3	6.2	Meets target	0	146	0
21	185	Science Lab	College of Alameda	Science Annex	3	3.2	Meets target	0	684	0
22	184	Science Lab	College of Alameda	Science Annex	4	8.3	Meets target	0	107	0
23	182	Science Lab	College of Alameda	Science Annex	3	5.0	Meets target	0	332	0
24	165A	Occupiable Storage (I	College of Alameda	Science Annex	3	8.6	Meets target with mitigation	58	64	167
25	A165A	Occupiable Storage (I	College of Alameda	Science Annex	3	8.2	Meets target with mitigation	61	67	167
26	160	Classroom	College of Alameda	Science Annex	4	4.5	Meets target with mitigation	500	550	566
27	161	Office	College of Alameda	Science Annex	3	8.5	Meets target with mitigation	59	65	167

#	HVAC		Site		Air Changes			Reccommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
28	158	Office	College of Alameda	Science Annex	3	10.0	Meets target with mitigation	50	55	167
29	157	Office	College of Alameda	Science Annex	3	10.0	Meets target with mitigation	50	55	167
30	159	Office	College of Alameda	Science Annex	3	4.4	Meets target with mitigation	108	139	167
31	153	Science Lab	College of Alameda	Science Annex	3	7.0	Meets target	0	175	0
32	151	Office	College of Alameda	Science Annex	3	11.1	Meets target with mitigation	45	50	167
33	156	Office	College of Alameda	Science Annex	3	10.8	Meets target	0	47	0
34	155	Science Lab	College of Alameda	Science Annex	5	11.8	Meets target	0	70	0
35	150	Science Lab	College of Alameda	Science Annex	3	13.4	Meets target with mitigation	0	796	120
36	152	Science Lab	College of Alameda	Science Annex	3	6.8	Meets target	0	194	0
37	100	Classroom	College of Alameda	Science Annex	4	4.2	Meets target with mitigation	699	769	733
38	104	Occupiable Storage (I	College of Alameda	Science Annex	3	4.0	Meets target with mitigation	126	138	167
39	102	Office	College of Alameda	Science Annex	3	9.1	Meets target with mitigation	55	61	167
40	110	Classroom	College of Alameda	Science Annex	5	5.0	Meets target with mitigation	839	993	845
41	131	Science Lab	College of Alameda	Science Annex	3	22.5	Meets target	0	159	0