




Ventilation Assessment Summary

Ventilation Assessment

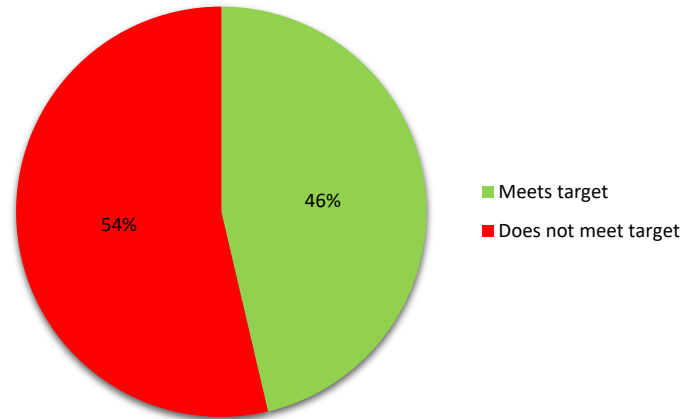

#	HVAC		Site		Air Changes				PAC	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	100	300
1	144	Science Lab	College of Alameda	Science Annex	3	0.0	Does not meet target	67	1	
2	143	Occupiable Storage (C	College of Alameda	Science Annex	3	0.0	Does not meet target	162	2	
3	141	Science Lab	College of Alameda	Science Annex	3	0.0	Does not meet target	45	1	
4	140	Classroom	College of Alameda	Science Annex	3	5.3	Meets target	0		
5	137	Occupiable Storage (C	College of Alameda	Science Annex	3	8.8	Meets target	0		
6	136	Science Lab	College of Alameda	Science Annex	3	5.4	Meets target	0		
7	135	Office	College of Alameda	Science Annex	3	5.0	Meets target	0		
8	166	Occupiable Storage (C	College of Alameda	Science Annex	3	0.0	Does not meet target	33	1	
9	134	Classroom	College of Alameda	Science Annex	4	4.4	Meets target	0		
10	133	Office	College of Alameda	Science Annex	3	5.8	Meets target	0		
11	130	Science Lab	College of Alameda	Science Annex	4	5.6	Meets target	0		
12	127	Break room	College of Alameda	Science Annex	3	0.0	Does not meet target	255		1
13	127	Multiuse Assembly	College of Alameda	Science Annex	3	0.0	Does not meet target	149	2	
14	124	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	186	2	
15	120	Reception Areas	College of Alameda	Science Annex	3	0.0	Does not meet target	189	2	
16	123	Lecture Room	College of Alameda	Science Annex	3	0.0	Does not meet target	115	2	
17	122	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	147	2	
18	180	Science Lab	College of Alameda	Science Annex	3	6.1	Meets target	0		
19	187	Science Lab	College of Alameda	Science Annex	3	16.0	Meets target	0		
20	186	Science Lab	College of Alameda	Science Annex	3	6.2	Meets target	0		
21	185	Science Lab	College of Alameda	Science Annex	3	3.2	Meets target	0		

#	HVAC		Site		Air Changes				PAC	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	100	300
22	184	Science Lab	College of Alameda	Science Annex	4	8.3	Meets target	0		
23	182	Science Lab	College of Alameda	Science Annex	3	5.0	Meets target	0		
24	165A	Occupiable Storage (L	College of Alameda	Science Annex	3	0.0	Does not meet target	58	1	
25	A165A	Occupiable Storage (L	College of Alameda	Science Annex	3	0.0	Does not meet target	61	1	
26	160	Classroom	College of Alameda	Science Annex	4	0.0	Does not meet target	500	2	1
27	161	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	59	2	
28	158	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	50	2	
29	157	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	50	2	
30	159	Office	College of Alameda	Science Annex	3	0.4	Does not meet target	108	2	
31	153	Science Lab	College of Alameda	Science Annex	3	7.0	Meets target	0		
32	151	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	45	2	
33	156	Office	College of Alameda	Science Annex	3	10.8	Meets target	0		
34	155	Science Lab	College of Alameda	Science Annex	5	11.8	Meets target	0		
35	150	Science Lab	College of Alameda	Science Annex	3	12.9	Meets target	0		
36	152	Science Lab	College of Alameda	Science Annex	3	6.8	Meets target	0		
37	100	Classroom	College of Alameda	Science Annex	4	0.2	Does not meet target	699	1	2
38	104	Occupiable Storage (L	College of Alameda	Science Annex	3	0.0	Does not meet target	126	2	
39	102	Office	College of Alameda	Science Annex	3	0.0	Does not meet target	55	1	
40	110	Classroom	College of Alameda	Science Annex	5	0.3	Does not meet target	839		3
41	131	Science Lab	College of Alameda	Science Annex	3	22.5	Meets target	0		