


Ventilation Assessment Summary

Ventilation Assessment

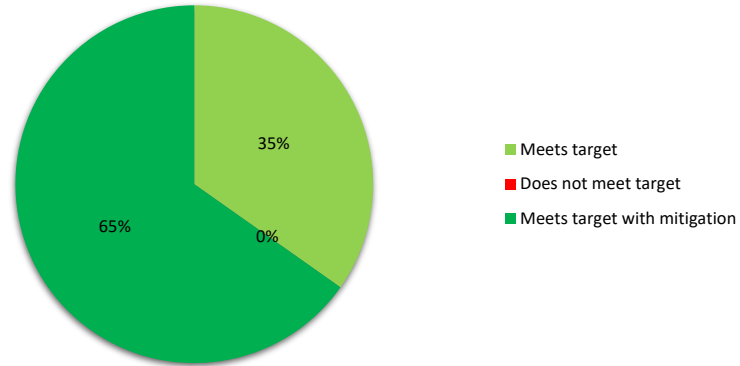

#	HVAC		Site		Air Changes			Reccomendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	Bookstore	Reception Areas	College of Alameda	Student Center	3	3.4	Meets target with mitigation	588	1182	725
2	F102	Office	College of Alameda	Student Center	3	7.0	Meets target	0	28	0
3	F121	Office	College of Alameda	Student Center	3	7.3	Meets target	0	48	0
4	F109	Office	College of Alameda	Student Center	3	7.7	Meets target with mitigation	24	101	167
5	F116	Reception Areas	College of Alameda	Student Center	3	9.1	Meets target with mitigation	55	60	167
6	F115	Office	College of Alameda	Student Center	3	10.5	Meets target	0	79	0
7	F117	Office	College of Alameda	Student Center	3	12.9	Meets target with mitigation	13	52	167
8	F122	Occupiable Storage (C	College of Alameda	Student Center	3	8.1	Meets target with mitigation	11	101	167
9	F105	Reception Areas	College of Alameda	Student Center	3	15.5	Meets target with mitigation	13	41	167
10	F105A	Office	College of Alameda	Student Center	3	3.7	Meets target	0	41	0
11	F105B	Office	College of Alameda	Student Center	3	10.8	Meets target with mitigation	16	63	167
12	F216	Conference	College of Alameda	Student Center	3	6.2	Meets target with mitigation	81	89	167
13	F212	Reception Areas	College of Alameda	Student Center	3	5.6	Meets target with mitigation	89	98	167
14	F212A	Conference	College of Alameda	Student Center	8	123.7	Meets target with mitigation	11	12	167
15	F212B	Office	College of Alameda	Student Center	3	12.2	Meets target with mitigation	41	45	167
16	F217	Office	College of Alameda	Student Center	3	5.7	Meets target with mitigation	89	98	167
17	F207	Locker Room	College of Alameda	Student Center	3	5.1	Meets target	0	45	0
18	F202	Occupiable Storage (C	College of Alameda	Student Center	3	37.9	Meets target	0	93	0
19	F203	Kitchen	College of Alameda	Student Center	3	26.3	Meets target	0	207	0
20	F211	Office	College of Alameda	Student Center	3	8.2	Meets target	0	40	0
21	space 2nd	Cafeteria	College of Alameda	Student Center	4	7.5	Meets target with mitigation	505	2793	2730
22	F217A	Office	College of Alameda	Student Center	3	9.9	Meets target with mitigation	50	55	167
23	space 1st	Multiuse Assembly	College of Alameda	Student Center	3	4.0	Meets target with mitigation	1989	2516	2730