




Ventilation Assessment Summary

Ventilation Assessment

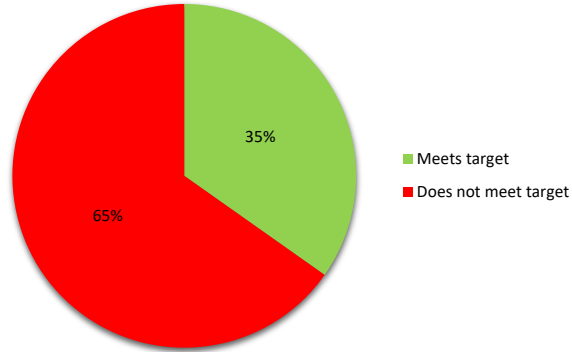

| # | HVAC | | Site | | Air Changes | | | | Halo | OR | PAC | | BSE-A-1000 |
|----|----------------------------|-----------------------|--------------------|----------------|-------------|--------|----------------------|-----------|---------|----|---------|---------|------------|
| | Room | Type | Campus | Building | Target | Actual | Result | Min. CADR | 120 cfm | | 100 cfm | 300 cfm | 1065 CFM |
| 1 | Bookstore | Reception Areas | College of Alameda | Student Center | 3 | 1.7 | Does not meet target | 588 | 3 | | | 2 | |
| 2 | F102 | Office | College of Alameda | Student Center | 3 | 7.0 | Meets target | 0 | | | | | |
| 3 | F121 | Office | College of Alameda | Student Center | 3 | 7.3 | Meets target | 0 | | | | | |
| 4 | F109 | Office | College of Alameda | Student Center | 3 | 2.2 | Does not meet target | 24 | 1 | 1 | | | |
| 5 | F116 | Reception Areas | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 55 | 1 | 1 | | | |
| 6 | F115 | Office | College of Alameda | Student Center | 3 | 10.5 | Meets target | 0 | | | | | |
| 7 | F117 | Office | College of Alameda | Student Center | 3 | 2.2 | Does not meet target | 13 | 1 | 1 | | | |
| 8 | F122 | Occupiable Storage (C | College of Alameda | Student Center | 3 | 2.7 | Does not meet target | 11 | 1 | 1 | | | |
| 9 | F105 | Reception Areas | College of Alameda | Student Center | 3 | 1.9 | Does not meet target | 13 | 1 | 1 | | | |
| 10 | F105A | Office | College of Alameda | Student Center | 3 | 3.7 | Meets target | 0 | | | | | |
| 11 | F105B | Office | College of Alameda | Student Center | 3 | 2.1 | Does not meet target | 16 | 1 | 1 | | | |
| 12 | F216 | Conference | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 81 | 1 | 1 | | | |
| 13 | F212 | Reception Areas | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 89 | 1 | 1 | | | |
| 14 | F212A | Conference | College of Alameda | Student Center | 8 | 0.0 | Does not meet target | 11 | 1 | 1 | | | |
| 15 | F212B | Office | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 41 | 1 | 1 | | | |
| 16 | F217 | Office | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 89 | 1 | 1 | | | |
| 17 | F207 | Locker Room | College of Alameda | Student Center | 3 | 5.1 | Meets target | 0 | | | | | |
| 18 | F202 | Occupiable Storage (C | College of Alameda | Student Center | 3 | 37.9 | Meets target | 0 | | | | | |
| 19 | F203 | Kitchen | College of Alameda | Student Center | 3 | 26.3 | Meets target | 0 | | | | | |
| 20 | F211 | Office | College of Alameda | Student Center | 3 | 8.2 | Meets target | 0 | | | | | |
| 21 | BUILDING I | Cafeteria | College of Alameda | Student Center | 4 | 3.2 | Does not meet target | 505 | 3 | | | 2 | |
| 22 | F217A | Office | College of Alameda | Student Center | 3 | 0.0 | Does not meet target | 50 | 1 | 1 | | | |
| 23 | Building F | Multiuse Assembly | College of Alameda | Student Center | 3 | 0.4 | Does not meet target | 1989 | | | | | 2 |