




Ventilation Assessment Summary

Ventilation Assessment

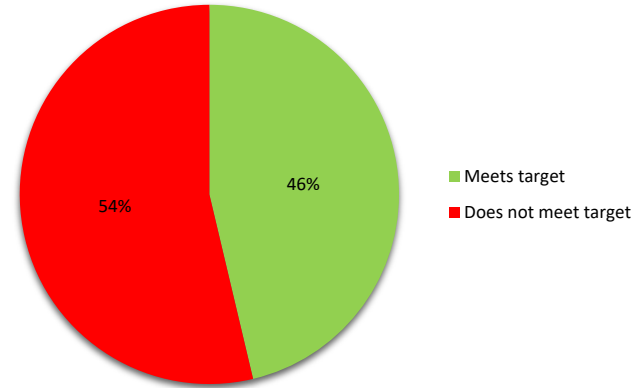

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	A100	Office	District Offices	Admissions & Records	3	7.4	Meets target	0	54
2	A103	Office	District Offices	Admissions & Records	3	5.6	Meets target	0	111
3	A104	Office	District Offices	Admissions & Records	3	7.1	Meets target	0	51
4	A108	Office	District Offices	Admissions & Records	3	6.7	Meets target	0	52
5	A109	Office	District Offices	Admissions & Records	3	3.8	Meets target	0	86
6	A110	Office	District Offices	Admissions & Records	3	3.3	Meets target	0	181
7	A113	Office	District Offices	Admissions & Records	3	1.1	Does not meet target	96	169
8	A111	Conference	District Offices	Admissions & Records	3	3.4	Meets target	0	96
9	A112	Office	District Offices	Admissions & Records	3	10.0	Meets target	0	52
10	A115	Break room	District Offices	Admissions & Records	3	7.8	Meets target	0	73
11	G175	Conference	District Offices	DGS	3	0.0	Does not meet target	184	203
12	G165	Break room	District Offices	DGS	3	11.3	Meets target	0	216
13	G176	Office	District Offices	DGS	3	0.8	Does not meet target	113	167
14	G189	Conference	District Offices	DGS	3	2.9	Does not meet target	2	84
15	G182	Office	District Offices	DGS	3	1.1	Does not meet target	167	297
16	G190	Office	District Offices	DGS	3	8.9	Meets target	0	84
17	G192	Office	District Offices	DGS	3	4.1	Meets target	0	73
18	G191	Office	District Offices	DGS	3	12.6	Meets target	0	72
19	G183	Office	District Offices	DGS	3	0.0	Does not meet target	56	62
20	G187	Conference	District Offices	DGS	3	1.7	Does not meet target	57	148
21	G186	Office	District Offices	DGS	3	6.3	Meets target	0	1166
22	Engineers	Office	District Offices	DGS	3	6.4	Meets target	0	229
23	G177	Lobby	District Offices	DGS	3	0.6	Does not meet target	450	627
24	G185	Office	District Offices	DGS	3	0.0	Does not meet target	50	55
25	G188	Conference	District Offices	DGS	3	0.0	Does not meet target	133	146

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
26	T164	Office	District Offices	DGS	3	1.6	Does not meet target	23	53
27	T163	Office	District Offices	DGS	3	0.0	Does not meet target	45	49
28	T162	Office	District Offices	DGS	3	1.4	Does not meet target	27	53
29	T161	Office	District Offices	DGS	3	0.0	Does not meet target	45	49
30	T155	Office	District Offices	DGS	3	18.5	Meets target	0	96
31	T153	Office	District Offices	DGS	3	51.7	Meets target	0	48
32	T151	Office	District Offices	DGS	3	3.5	Meets target	0	48
33	T143	Office	District Offices	DGS	3	1.2	Does not meet target	26	49
34	T141	Office	District Offices	DGS	3	0.0	Does not meet target	48	53
35	T154	Conference	District Offices	DGS	3	1.8	Does not meet target	45	122
36	T149	Office	District Offices	DGS	3	0.0	Does not meet target	50	55
37	T139	Office	District Offices	DGS	3	4.7	Meets target	14	46
38	T137	Office	District Offices	DGS	3	2.1	Does not meet target	12	41
39	T152	Computer Lab	District Offices	DGS	3	1.7	Does not meet target	42	105
40	T-Lobby	Reception Areas	District Offices	DGS	3	1.2	Does not meet target	566	1032
41	T133	Office	District Offices	DGS				#VALUE!	#VALUE!
42	P110	Occupiable Storage (Dry)	District Offices	DGS	3	19.8	Meets target	0	241
43	P120	Office	District Offices	DGS				#VALUE!	#VALUE!
44	Warehouse(1)	Occupiable Storage (Dry)	District Offices	DGS	3	0.0	Does not meet target	1771	1949
45	Warehouse(2)	Occupiable Storage (Dry)	District Offices	DGS	3	0.0	Does not meet target	20482	22543
46	P117	Office	District Offices	DGS	3	0.0	Does not meet target	98	107
47	P108	Office	District Offices	DGS	3	5.1	Meets target	0	96
48	P107	Office	District Offices	DGS	3	3.6	Meets target	0	96
49	P101	Office	District Offices	DGS	3	2.9	Does not meet target	4	143
50	P102	Office	District Offices	DGS	3	4.8	Meets target	0	80
51	P103	Office	District Offices	DGS	3	2.1	Does not meet target	23	81
52	P106	Office	District Offices	DGS	3	7.5	Meets target	0	65

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
53	Purchasing Dept Lobby	Reception Areas	District Offices	DGS	3	5.8	Meets target	0	446
54	M1	Reception Areas	District Offices	DGS	3	0.0	Does not meet target	150	165
55	M1	Office	District Offices	DGS	3	0.0	Does not meet target	52	57
56	M3	Occupiable Storage (Dry)	District Offices	DGS	3	0.0	Does not meet target	65	72