




Ventilation Assessment Summary

Ventilation Assessment

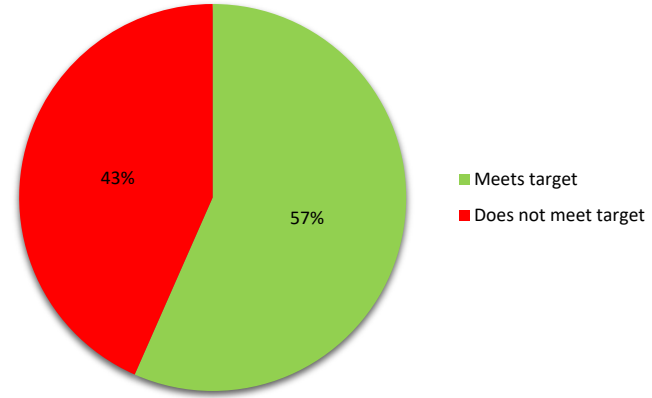

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	B24	Office	District Offices	Finance & HR	3	4.0	Meets target	0	87
2	B23	Office	District Offices	Finance & HR	3	8.9	Meets target	0	70
3	B22	Office	District Offices	Finance & HR	3	8.1	Meets target	0	70
4	B21	Office	District Offices	Finance & HR	3	8.2	Meets target	0	69
5	B20	Office	District Offices	Finance & HR	3	3.7	Meets target	0	69
6	B19	Office	District Offices	Finance & HR	3	6.0	Meets target	0	105
7	B26D	Office	District Offices	Finance & HR	3	1.5	Does not meet target	19	42
8	B26E	Office	District Offices	Finance & HR	3	3.6	Meets target	0	43
9	B25A	Conference	District Offices	Finance & HR	3	1.6	Does not meet target	39	92
10	HR Lobby / Cubicle Office	Office	District Offices	Finance & HR	3	1.6	Does not meet target	428	986
11	B17A	Office	District Offices	Finance & HR	3	7.0	Meets target	0	65
12	Payroll	Office	District Offices	Finance & HR	3	8.2	Meets target	0	357
13	B16	Office	District Offices	Finance & HR	3	7.3	Meets target	0	104
14	B11	Office	District Offices	Finance & HR	3	3.0	Meets target	0	69
15	B10	Office	District Offices	Finance & HR	3	0.0	Does not meet target	62	68
16	B13	Office	District Offices	Finance & HR	3	2.6	Does not meet target	8	69
17	B14	Office	District Offices	Finance & HR	3	7.8	Meets target	0	67
18	B15	Office	District Offices	Finance & HR	3	8.6	Meets target	0	71
19	A26	Office	District Offices	Finance & HR	3	6.1	Meets target	0	126
20	A1	Lecture Room	District Offices	Finance & HR	4	0.0	Does not meet target	1000	1101
21	B1M	Office	District Offices	Finance & HR	3	13.4	Meets target	0	52
22	B1J	Office	District Offices	Finance & HR	3	9.1	Meets target	0	71
23	B1C	Conference	District Offices	Finance & HR	3	8.1	Meets target	0	71
24	B1B	Office	District Offices	Finance & HR	3	4.5	Meets target	0	45

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
25	B1A	Office	District Offices	Finance & HR	3	11.8	Meets target	0	48
26	B1L	Office	District Offices	Finance & HR	3	10.1	Meets target	0	53
27	B1K	Office	District Offices	Finance & HR	3	4.7	Meets target	0	134
28	B1H	Office	District Offices	Finance & HR	3	9.1	Meets target	0	68
29	B1G	Office	District Offices	Finance & HR	3	2.9	Does not meet target	3	100
30	B1F	Office	District Offices	Finance & HR	3	7.1	Meets target	0	47
31	B1E	Office	District Offices	Finance & HR	3	14.2	Meets target	0	48
32	B1D	Office	District Offices	Finance & HR	3	10.5	Meets target	0	68
33	C5	Office	District Offices	Finance & HR	3	0.0	Does not meet target	43	47
34	C4	Office	District Offices	Finance & HR	3	0.0	Does not meet target	49	53
35	C7	Conference	District Offices	Finance & HR	3	0.0	Does not meet target	117	129
36	A17	Break room	District Offices	Finance & HR	3	8.1	Meets target	0	313
37	C3B	Office	District Offices	Finance & HR	3	2.3	Does not meet target	50	55
38	A5	Office	District Offices	Finance & HR	3	6.9	Meets target	0	195
39	A14A	Conference	District Offices	Finance & HR	3	7.6	Meets target	0	187
40	A11	Office	District Offices	Finance & HR	3	0.0	Does not meet target	69	76
41	A12	Kitchen	District Offices	Finance & HR	3	0.0	Does not meet target	90	99
42	A9A	Office	District Offices	Finance & HR	3	0.0	Does not meet target	44	48
43	C1	Select Category	District Offices	Finance & HR				#VALUE!	#VALUE!
44	C3A	Office	District Offices	Finance & HR	3	0.0	Does not meet target	49	53
45	C3C	Office	District Offices	Finance & HR	3	0.0	Does not meet target	54	59
46	A20	Select Category	District Offices	Finance & HR				#VALUE!	#VALUE!
47	A22	Select Category	District Offices	Finance & HR				#VALUE!	#VALUE!
48	A23	Office	District Offices	Finance & HR	3	0.0	Does not meet target	60	66
49	A21	Break room	District Offices	Finance & HR	3	0.0	Does not meet target	65	72
50	A25	Office	District Offices	Finance & HR	3	0.0	Does not meet target	248	272
51	S38	Office	District Offices	Finance & HR	3	0.0	Does not meet target	216	238
52	S33	Office	District Offices	Finance & HR	3	1.7	Does not meet target	26	67

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
53	S37	Office	District Offices	Finance & HR	3	0.0	Does not meet target	62	68
54	S36	Office	District Offices	Finance & HR	3	6.6	Meets target	0	67
55	S31	Office	District Offices	Finance & HR	3	14.1	Meets target	0	61
56	S34	Break room	District Offices	Finance & HR	3	0.0	Does not meet target	59	65