




## Ventilation Assessment Summary

### Ventilation Assessment

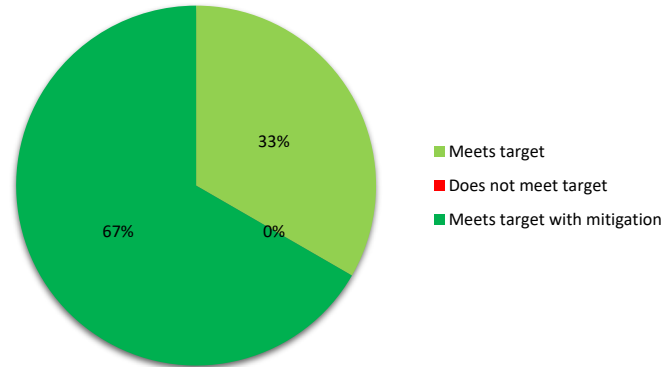

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<a href="#">105</a>	Break room	District Offices	International Affairs	3	10.4	Meets target with mitigation	48	53	167
2	<a href="#">104</a>	Office	District Offices	International Affairs	3	10.5	Meets target with mitigation	48	52	167
3	<a href="#">101</a>	Office	District Offices	International Affairs	3	10.4	Meets target with mitigation	48	53	167
4	<a href="#">103</a>	Office	District Offices	International Affairs	3	9.7	Meets target	0	48	0
5	<a href="#">100</a>	Conference	District Offices	International Affairs	3	5.7	Meets target	0	122	0
6	<a href="#">1</a>	Office	District Offices	International Affairs	3	10.5	Meets target with mitigation	48	53	167
7	<a href="#">2</a>	Office	District Offices	International Affairs	3	11.6	Meets target with mitigation	43	48	167
8	<a href="#">3</a>	Office	District Offices	International Affairs	3	11.6	Meets target with mitigation	43	48	167
9	<a href="#">4</a>	Office	District Offices	International Affairs	3	11.5	Meets target with mitigation	44	48	167
10	<a href="#">5</a>	Office	District Offices	International Affairs	3	6.0	Meets target with mitigation	84	92	167
11	<a href="#">IA-A</a>	Office	District Offices	International Affairs	3	7.2	Meets target	0	374	0
12	<a href="#">IA-B</a>	Office	District Offices	International Affairs	3	10.8	Meets target	0	176	0