




## Ventilation Assessment Summary

### Ventilation Assessment

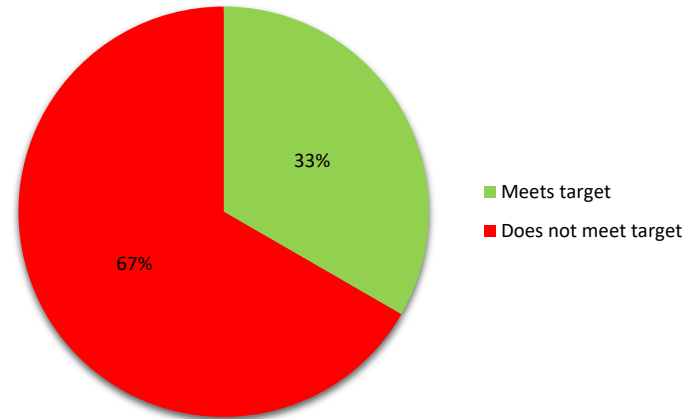

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	<a href="#">105</a>	Break room	District Offices	International Affairs	3	0.0	Does not meet target	48	53
2	<a href="#">104</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	48	52
3	<a href="#">101</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	48	53
4	<a href="#">103</a>	Office	District Offices	International Affairs	3	9.7	Meets target	0	48
5	<a href="#">100</a>	Conference	District Offices	International Affairs	3	5.7	Meets target	0	122
6	<a href="#">1</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	48	53
7	<a href="#">2</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	43	48
8	<a href="#">3</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	43	48
9	<a href="#">4</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	44	48
10	<a href="#">5</a>	Office	District Offices	International Affairs	3	0.0	Does not meet target	84	92
11	<a href="#">IA-A</a>	Office	District Offices	International Affairs	3	7.2	Meets target	0	92
12	<a href="#">IA-B</a>	Office	District Offices	International Affairs	3	10.8	Meets target	0	92