


Ventilation Assessment Summary

Ventilation Assessment

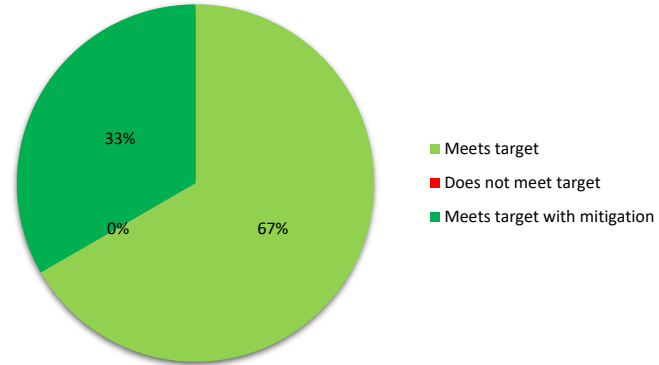

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	Lobby	Lobby	District Offices	Radio-TV	3	5.0	Meets target with mitigation	169	186	279
2	Office 1	Office	District Offices	Radio-TV	3	4.9	Meets target with mitigation	103	113	167
3	PCTV Broadcast	Office	District Offices	Radio-TV	3	13.4	Meets target	0	125	0
4	PCTV Main	Office	District Offices	Radio-TV	3	7.1	Meets target	0	186	0
5	KGPC Recording	Office	District Offices	Radio-TV	3	3.4	Meets target	0	139	0
6	KGPC Broadcast	Office	District Offices	Radio-TV	3	12.3	Meets target	0	139	0