




Ventilation Assessment Summary

Ventilation Assessment

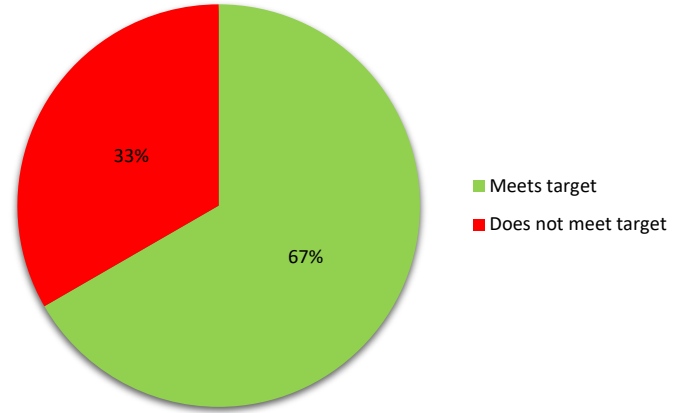

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	Lobby	Lobby	District Offices	Radio-TV	3	2.5	Does not meet target	169	186
2	Office 1	Office	District Offices	Radio-TV	3	0.0	Does not meet target	103	113
3	PCTV Broadcast	Office	District Offices	Radio-TV	3	13.4	Meets target	0	125
4	PCTV Main	Office	District Offices	Radio-TV	3	7.1	Meets target	0	186
5	KGPC Recording	Office	District Offices	Radio-TV	3	3.4	Meets target	0	139
6	KGPC Broadcast	Office	District Offices	Radio-TV	3	12.3	Meets target	0	139