




Ventilation Assessment Summary

Ventilation Assessment

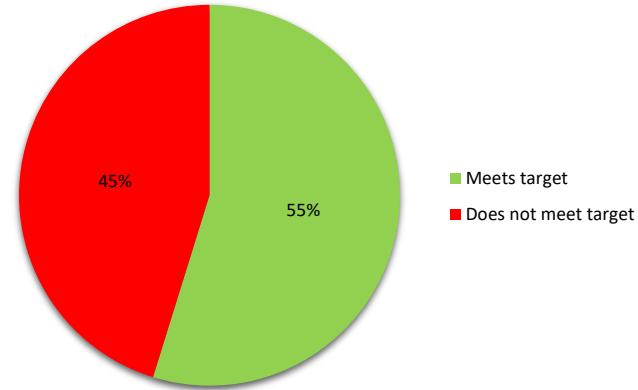

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	A201	Reception Areas	Laney College	A Complex	3	1.1	Does not meet target	336	597
2	A203	Classroom	Laney College	A Complex	3	6.3	Meets target	0	825
3	A201A	Office	Laney College	A Complex	3	1.1	Does not meet target	298	510
4	A202	Office	Laney College	A Complex	3	5.1	Meets target	0	1278
5	A203A	Office	Laney College	A Complex	3	9.8	Meets target	0	72
6	A202B	Office	Laney College	A Complex	3	17.5	Meets target	0	70
7	A203B	Office	Laney College	A Complex	3	11.0	Meets target	0	68
8	A203C	Break room	Laney College	A Complex	3	3.2	Meets target	0	100
9	A204	Classroom	Laney College	A Complex	3	0.7	Does not meet target	514	734
10	A236	Science Lab	Laney College	A Complex	3	4.2	Meets target	0	848
11	A237A	Office	Laney College	A Complex	3	13.0	Meets target	0	70
12	A204A	Office	Laney College	A Complex	3	15.7	Meets target	0	30
13	A204B	Office	Laney College	A Complex	3	6.5	Meets target	0	51
14	A236A	Office	Laney College	A Complex	3	12.7	Meets target	0	69
15	A235	Science Lab	Laney College	A Complex	3	14.2	Meets target	0	711
16	A235B	Science Lab	Laney College	A Complex	3	5.1	Meets target	0	290
17	A239	Classroom	Laney College	A Complex	6	7.1	Meets target	0	642
18	A279	Occupiable Storage (L	Laney College	A Complex	3	12.0	Meets target	0	159
19	A270	Office	Laney College	A Complex	3	11.0	Meets target	0	71
20	A272	Science Lab	Laney College	A Complex	3	6.0	Meets target	0	271
21	A278	Occupiable Storage (L	Laney College	A Complex	3	13.4	Meets target	0	162
22	A271	Science Lab	Laney College	A Complex	4	4.1	Meets target	0	641
23	A273	Lecture Room	Laney College	A Complex	3	10.9	Meets target	0	248
24	A277	Science Lab	Laney College	A Complex	3	8.4	Meets target	0	688

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
25	A274	Science Lab	Laney College	A Complex	4	11.2	Meets target	0	644
26	A274A	Occupiable Storage (L	Laney College	A Complex	3	0.0	Does not meet target	69	76
27	A277A	Science Lab	Laney College	A Complex	3	2.6	Does not meet target	8	66
28	A275	Office	Laney College	A Complex	3	13.7	Meets target	0	73
29	A276	Office	Laney College	A Complex	3	13.4	Meets target	0	72
30	A266	Classroom	Laney College	A Complex	5	4.4	Does not meet target	97	888
31	A185	Office	Laney College	A Complex	3	2.4	Does not meet target	10	56
32	A184	Classroom	Laney College	A Complex	5	0.0	Does not meet target	122	135
33	A183	Computer Lab	Laney College	A Complex	4	0.0	Does not meet target	92	101
34	o Hallways and Common A	Lobby	Laney College	A Complex	3	0.7	Does not meet target	358	514
35	A237	Science Lab	Laney College	A Complex	3	4.2	Meets target	0	710
36	A164	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
37	A165	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
38	A166	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
39	A167	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
40	A168	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	44	48
41	A170	Science Lab	Laney College	A Complex	6	0.0	Does not meet target	40	44
42	A169	Science Lab	Laney College	A Complex	6	0.0	Does not meet target	40	44
43	A171	Science Lab	Laney College	A Complex	6	0.0	Does not meet target	40	44
44	A172	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
45	A173	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22
46	A174	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	42	46
47	A175	Occupiable Storage (L	Laney College	A Complex	3	0.0	Does not meet target	20	22
48	A176	Occupiable Storage (L	Laney College	A Complex	3	0.0	Does not meet target	32	35
49	A177	Office	Laney College	A Complex	3	0.0	Does not meet target	41	45
50	A179 / A180	Lecture Room	Laney College	A Complex	3	1.3	Does not meet target	822	1609
51	A178 / A162	Science Lab	Laney College	A Complex	4	0.0	Does not meet target	440	484
52	A165	Science Lab	Laney College	A Complex	3	0.0	Does not meet target	20	22

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
53	A190	Occupiable Storage (E	Laney College	A Complex	3	7.1	Meets target	0	119
54	A192	Office	Laney College	A Complex	3	3.5	Meets target	0	53
55	A191A/ A191B	Science Lab	Laney College	A Complex	3	10.7	Meets target	0	1468
56	A191C / A192	Science Lab	Laney College	A Complex	3	12.6	Meets target	0	1192
57	A153 / A154	Art Classroom	Laney College	A Complex	3	4.4	Meets target	0	2959
58	A152	Art Classroom	Laney College	A Complex	3	9.9	Meets target	0	2412
59	A151	Office	Laney College	A Complex	3	5.1	Meets target	0	67
60	A140	Classroom	Laney College	A Complex	4	17.2	Meets target	0	241
61	A150-A154	Reception Areas	Laney College	A Complex	3	0.7	Does not meet target	899	1266
62	A120	Classroom	Laney College	A Complex	6	5.8	Does not meet target	268	549
63	A109	Reception Areas	Laney College	A Complex	3	2.4	Does not meet target	209	1098
64	A105	Lecture Room	Laney College	A Complex	3	5.8	Meets target	0	1275
65	A101A	Office	Laney College	A Complex	3	1.6	Does not meet target	187	187
66	A107	Office	Laney College	A Complex	3	3.5	Meets target	0	54
67	A106 Lobby	Reception Areas	Laney College	A Complex	3	3.4	Meets target	0	562
68	A106	Office	Laney College	A Complex	3	2.9	Does not meet target	49	1451
69	A101B	Reception Areas	Laney College	A Complex	3	8.6	Meets target	0	691
70	A106B	Office	Laney College	A Complex	3	1.6	Does not meet target	99	230
71	A106A	Office	Laney College	A Complex	3	3.2	Meets target	0	109
72	A101B Office	Office	Laney College	A Complex	3	3.1	Meets target	0	128
73	A108	Office	Laney College	A Complex	3	4.5	Meets target	0	53