




## Ventilation Assessment Summary

### Ventilation Assessment

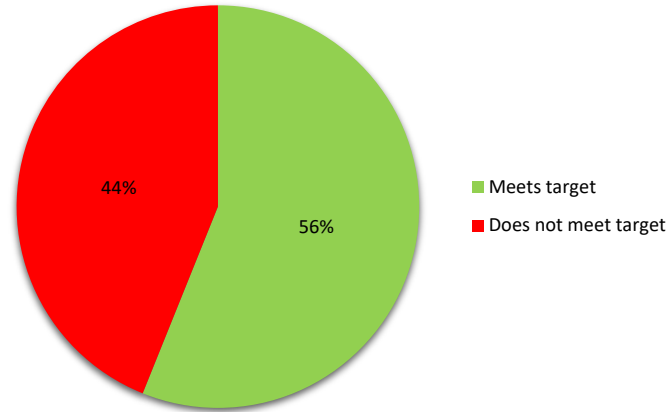

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	<a href="#">B120/123</a>	Classroom	Laney College	B	3	2.4	Does not meet target	564	3038
2	<a href="#">B122</a>	Office	Laney College	B	3	1.8	Does not meet target	22	61
3	<a href="#">B258</a>	Office	Laney College	B	3	0.0	Does not meet target	98	108
4	<a href="#">B260</a>	Classroom	Laney College	B	4	0.9	Does not meet target	305	432
5	<a href="#">B104</a>	Office	Laney College	B	3	0.0	Does not meet target	36	40
6	<a href="#">B111</a>	Occupiable Storage (C	Laney College	B	3	0.0	Does not meet target	32	35
7	<a href="#">B204B</a>	Science Lab	Laney College	B	3	2.7	Does not meet target	29	332
8	<a href="#">B205</a>	Science Lab	Laney College	B	3	0.0	Does not meet target	79	87
9	<a href="#">B206</a>	Science Lab	Laney College	B	3	0.0	Does not meet target	79	87
10	<a href="#">B253</a>	Classroom	Laney College	B	5	0.0	Does not meet target	407	448
11	<a href="#">B252</a>	Classroom	Laney College	B	5	0.0	Does not meet target	361	397
12	<a href="#">B266</a>	Classroom	Laney College	B	4	0.0	Does not meet target	300	330
13	<a href="#">B112</a>	Occupiable Storage (C	Laney College	B	3	0.0	Does not meet target	219	241
14	<a href="#">B256</a>	Classroom	Laney College	B	5	3.6	Does not meet target	145	406
15	<a href="#">B123B (121)</a>	Office	Laney College	B	3	0.0	Does not meet target	219	241
16	<a href="#">B123A</a>	Occupiable Storage (C	Laney College	B	3	0.0	Does not meet target	79	87
17	<a href="#">B152 A</a>	Occupiable Storage (C	Laney College	B	3	0.0	Does not meet target	266	293
18	<a href="#">B154</a>	Occupiable Storage (C	Laney College	B	3	2.0	Does not meet target	98	313
19	<a href="#">B151</a>	Office	Laney College	B	3	7.5	Meets target	0	65
20	<a href="#">B153</a>	Classroom	Laney College	B	4	6.0	Meets target	0	507
21	<a href="#">B150/152</a>	Wood/Metal Shop	Laney College	B	3	5.3	Meets target	0	6218
22	<a href="#">B130</a>	Classroom	Laney College	B	5	5.6	Meets target	0	753

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
23	<a href="#">B257</a>	Classroom	Laney College	B	7	14.2	Meets target	0	577
24	<a href="#">B261</a>	Classroom	Laney College	B	6	12.8	Meets target	0	470
25	<a href="#">B262</a>	Classroom	Laney College	B	6	19.2	Meets target	0	494
26	<a href="#">B263</a>	Occupiable Storage (C	Laney College	B	3	3.6	Meets target	0	92
27	<a href="#">B264</a>	Classroom	Laney College	B	5	8.9	Meets target	0	548
28	<a href="#">B267</a>	Office	Laney College	B	3	13.1	Meets target	0	108
29	<a href="#">B265</a>	Classroom	Laney College	B	6	10.2	Meets target	0	478
30	<a href="#">B251</a>	Office	Laney College	B	3	17.9	Meets target	0	116
31	<a href="#">B100/101/103</a>	Beauty and nail salon:	Laney College	B	3	3.7	Meets target	0	2238
32	<a href="#">B105</a>	Beauty and nail salon:	Laney College	B	3	8.0	Meets target	0	82
33	<a href="#">B210</a>	Classroom	Laney College	B	5	8.3	Meets target	0	883
34	<a href="#">B200</a>	Science Lab	Laney College	B	3	13.4	Meets target	0	157
35	<a href="#">B106</a>	Office	Laney College	B	3	4.2	Meets target	0	40
36	<a href="#">B101A/102</a>	Science Lab	Laney College	B	3	9.6	Meets target	0	106
37	<a href="#">B201</a>	Science Lab	Laney College	B	3	7.4	Meets target	0	505
38	<a href="#">B202</a>	Science Lab	Laney College	B	4	5.9	Meets target	0	645
39	<a href="#">B203</a>	Science Lab	Laney College	B	4	8.6	Meets target	0	638
40	<a href="#">B204</a>	Office	Laney College	B	3	4.2	Meets target	0	47
41	<a href="#">B207</a>	Science Lab	Laney College	B	4	8.3	Meets target	0	643