




Ventilation Assessment Summary

Ventilation Assessment

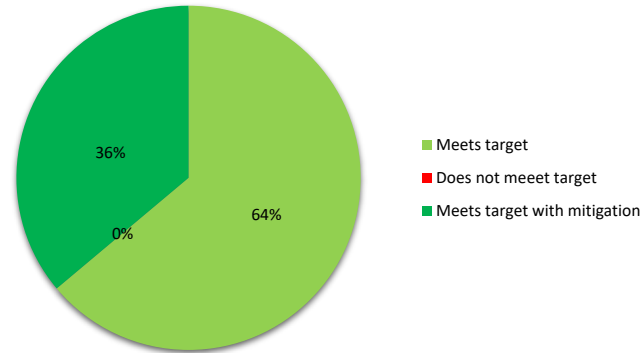

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	B120/123	Classroom	Laney College	B	3	3.0	Meets target with mitigation	564	3038	460
2	B122	Office	Laney College	B	3	14.2	Meets target with mitigation	22	61	230
3	B258	Office	Laney College	B	3	7.0	Meets target with mitigation	98	108	230
4	B260	Classroom	Laney College	B	4	5.6	Meets target with mitigation	305	432	460
5	B104	Office	Laney College	B	3	19.0	Meets target with mitigation	36	40	230
6	B111	Occupiable Storage (C	Laney College	B	3	21.6	Meets target with mitigation	32	35	230
7	B204B	Science Lab	Laney College	B	3	5.0	Meets target with mitigation	29	332	230
8	B205	Science Lab	Laney College	B	3	8.8	Meets target with mitigation	79	87	230
9	B206	Science Lab	Laney College	B	3	8.8	Meets target with mitigation	79	87	230
10	B253	Classroom	Laney College	B	5	5.6	Meets target with mitigation	407	448	460
11	B252	Classroom	Laney College	B	5	6.4	Meets target with mitigation	361	397	460
12	B266	Classroom	Laney College	B	4	6.1	Meets target with mitigation	300	330	460
13	B123B (121)	Office	Laney College	B	3	3.2	Meets target with mitigation	219	241	230
14	B151	Office	Laney College	B	3	7.5	Meets target	0	65	0
15	B153	Classroom	Laney College	B	4	6.0	Meets target	0	507	0
16	B150/152	Wood/Metal Shop	Laney College	B	3	5.3	Meets target	0	6218	0
17	B130	Classroom	Laney College	B	5	5.6	Meets target	0	753	0
18	B257	Classroom	Laney College	B	7	14.2	Meets target	0	577	0
19	B261	Classroom	Laney College	B	6	12.8	Meets target	0	470	0
20	B262	Classroom	Laney College	B	6	19.2	Meets target	0	494	0
21	B263	Occupiable Storage (C	Laney College	B	3	3.6	Meets target	0	92	0
22	B264	Classroom	Laney College	B	5	8.9	Meets target	0	548	0
23	B267	Office	Laney College	B	3	13.1	Meets target	0	108	0
24	B265	Classroom	Laney College	B	6	10.2	Meets target	0	478	0
25	B251	Office	Laney College	B	3	17.9	Meets target	0	116	0
26	B100/101/103	Beauty and nail salon:	Laney College	B	3	3.7	Meets target	0	2238	0
27	B105	Beauty and nail salon:	Laney College	B	3	8.0	Meets target	0	82	0
28	B210	Classroom	Laney College	B	5	8.3	Meets target	0	883	0
29	B200	Science Lab	Laney College	B	3	13.4	Meets target	0	157	0

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
30	B106	Office	Laney College	B	3	4.2	Meets target	0	40	0
31	B101A/102	Science Lab	Laney College	B	3	9.6	Meets target	0	106	0
32	B201	Science Lab	Laney College	B	3	7.4	Meets target	0	505	0
33	B202	Science Lab	Laney College	B	4	5.9	Meets target	0	645	0
34	B203	Science Lab	Laney College	B	4	8.6	Meets target	0	638	0
35	B204	Office	Laney College	B	3	4.2	Meets target	0	47	0
36	B207	Science Lab	Laney College	B	4	8.3	Meets target	0	643	0