


Ventilation Assessment Summary

Ventilation Assessment

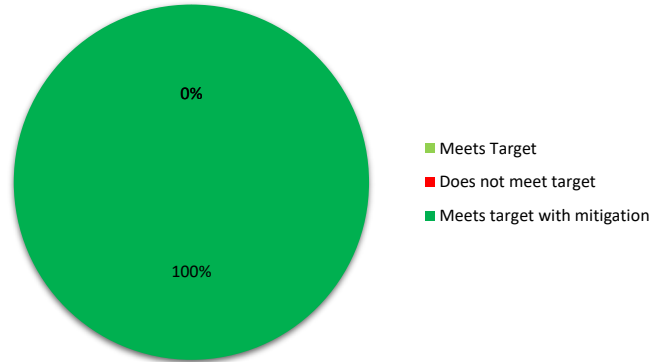

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	BC 101-102	Lecture Room	Laney College	Best	3	3.2	Meets target with mitigation	230	756	279