




Ventilation Assessment Summary

Ventilation Assessment

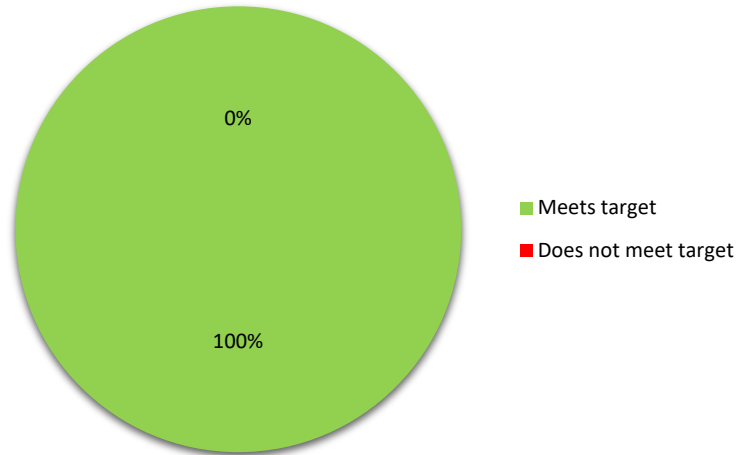

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
1	E101	Office	Laney College	E	3	4.5	Meets target	0	
2	E121	Classroom	Laney College	E	3	7.2	Meets target	0	
3	E103	Office	Laney College	E	3	4.2	Meets target	0	
4	E105	Lecture Room	Laney College	E	3	4.9	Meets target	0	
5	E116	Classroom	Laney College	E	3	8.2	Meets target	0	
6	E102	Kitchen	Laney College	E	3	21.1	Meets target	0	
7	E107	Office	Laney College	E	3	3.3	Meets target	0	
8	E123	Occupiable Storage (D	Laney College	E	3	5.6	Meets target	0	
9	E122	Office	Laney College	E	3	6.9	Meets target	0	