




Ventilation Assessment Summary

Ventilation Assessment

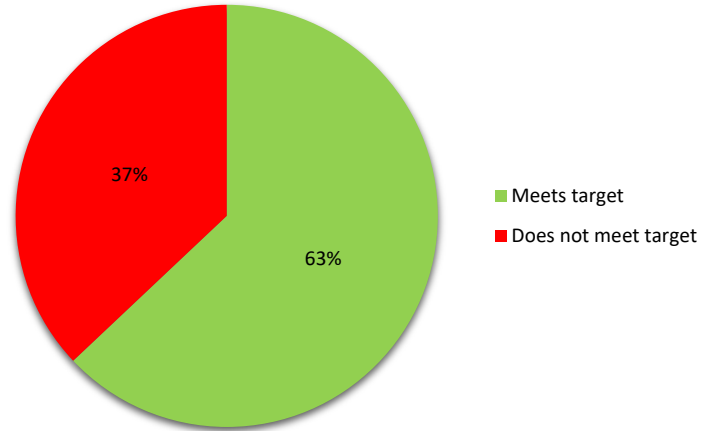

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	E254	Classroom	Laney College	Building E	4	9.9	Meets target	0	440
2	E255	Classroom	Laney College	Building E	3	1.7	Does not meet target	197	505
3	E255B	Classroom	Laney College	Building E	4	1.3	Does not meet target	270	434
4	E256	Classroom	Laney College	Building E	6	8.6	Meets target	0	518
5	E257	Classroom	Laney College	Building E	5	4.0	Does not meet target	76	421
6	E260	Break room	Laney College	Building E	3	4.1	Meets target	0	126
7	E260A	Office	Laney College	Building E	3	2.8	Does not meet target	3	41
8	E260B	Office	Laney College	Building E	3	3.0	Meets target	0	41
9	E260C	Office	Laney College	Building E	3	3.0	Meets target	0	44
10	E260D	Computer	Laney College	Building E	3	2.0	Does not meet target	20	63
11	E261	Computer Lab	Laney College	Building E	3	2.3	Does not meet target	57	270
12	E261A	Computer Lab	Laney College	Building E	3	5.9	Meets target	0	40
13	E261B	Office	Laney College	Building E	3	6.1	Meets target	0	43
14	E259A	Office	Laney College	Building E	3	21.1	Meets target	0	44
15	E259	Classroom	Laney College	Building E	5	10.6	Meets target	0	211
16	E211	Classroom	Laney College	Building E	5	7.7	Meets target	0	838
17	E210	Occupiable Storage (L	Laney College	Building E	3	10.0	Meets target	0	73
18	E200	Classroom	Laney College	Building E	5	3.8	Does not meet target	119	554
19	E201A	Classroom	Laney College	Building E	6	6.2	Meets target	0	503
20	E201B	Classroom	Laney College	Building E	5	5.2	Meets target	0	549

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
21	E201C	Office	Laney College	Building E	3	15.9	Meets target	0	105
22	E202A	Classroom	Laney College	Building E	5	4.7	Does not meet target	27	554
23	E202B	Classroom	Laney College	Building E	6	3.1	Does not meet target	217	501
24	E204	Classroom	Laney College	Building E	5	3.1	Does not meet target	191	551
25	E205	Office	Laney College	Building E	3	7.2	Meets target	0	104
26	E207	Classroom	Laney College	Building E	5	6.6	Meets target	0	838
27	E203	Office	Laney College	Building E	3	4.9	Meets target	0	163
28	E251	Lobby	Laney College	Building E	3	1.7	Does not meet target	139	345
29	E251A	Office	Laney College	Building E	3	3.2	Meets target	0	67
30	E251B	Office	Laney College	Building E	3	3.5	Meets target	0	57
31	E251C	Occupiable Storage (C	Laney College	Building E	3	8.7	Meets target	0	26
32	E251D	Office	Laney College	Building E	3	3.9	Meets target	0	68
33	E251E	Office	Laney College	Building E	3	4.1	Meets target	0	67
34	E251F	Office	Laney College	Building E	3	4.9	Meets target	0	64
35	E253A	Office	Laney College	Building E	3	4.0	Meets target	0	65
36	E253B	Office	Laney College	Building E	3	4.7	Meets target	0	63