




## Ventilation Assessment Summary

### Ventilation Assessment

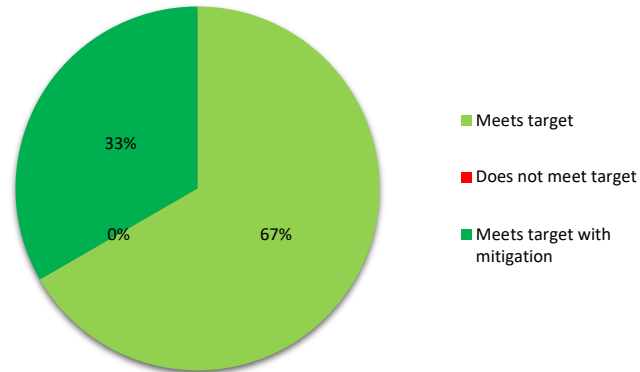

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<a href="#">E254</a>	Classroom	Laney College	Building E	4	8.5	Meets target	0	440	0
2	<a href="#">E255</a>	Classroom	Laney College	Building E	3	3.2	Meets target with mitigation	197	505	230
3	<a href="#">E255B</a>	Classroom	Laney College	Building E	4	4.0	Meets target with mitigation	270	434	230
4	<a href="#">E256</a>	Classroom	Laney College	Building E	6	8.6	Meets target	0	518	0
5	<a href="#">E257</a>	Classroom	Laney College	Building E	5	7.0	Meets target with mitigation	76	421	230
6	<a href="#">E260</a>	Break room	Laney College	Building E	3	4.1	Meets target	0	126	0
7	<a href="#">E260A</a>	Office	Laney College	Building E	3	3.0	Meets target	3	41	0
8	<a href="#">E260B</a>	Office	Laney College	Building E	3	3.0	Meets target	0	41	0
9	<a href="#">E260C</a>	Office	Laney College	Building E	3	3.0	Meets target	0	44	0
10	<a href="#">E260D</a>	Computer	Laney College	Building E	3	14.0	Meets target with mitigation	20	63	230
11	<a href="#">E261</a>	Computer Lab	Laney College	Building E	3	5.1	Meets target with mitigation	57	270	230
12	<a href="#">E261A</a>	Computer Lab	Laney College	Building E	3	5.9	Meets target	0	40	0
13	<a href="#">E261B</a>	Office	Laney College	Building E	3	6.1	Meets target	0	43	0
14	<a href="#">E259A</a>	Office	Laney College	Building E	3	21.1	Meets target	0	44	0
15	<a href="#">E259</a>	Classroom	Laney College	Building E	5	10.6	Meets target	0	211	0
16	<a href="#">E211</a>	Classroom	Laney College	Building E	5	7.7	Meets target	0	838	0
17	<a href="#">E210</a>	Occupiable Storage (C	Laney College	Building E	3	10.0	Meets target	0	73	0
18	<a href="#">E200</a>	Classroom	Laney College	Building E	5	6.1	Meets target with mitigation	119	554	230
19	<a href="#">E201A</a>	Classroom	Laney College	Building E	6	6.2	Meets target	0	503	0
20	<a href="#">E201B</a>	Classroom	Laney College	Building E	5	5.2	Meets target	0	549	0
21	<a href="#">E201C</a>	Office	Laney College	Building E	3	15.9	Meets target	0	105	0
22	<a href="#">E202A</a>	Classroom	Laney College	Building E	5	7.0	Meets target with mitigation	27	554	230
23	<a href="#">E202B</a>	Classroom	Laney College	Building E	6	6.2	Meets target with mitigation	217	501	230
24	<a href="#">E204</a>	Classroom	Laney College	Building E	5	5.4	Meets target with mitigation	191	551	230
25	<a href="#">E205</a>	Office	Laney College	Building E	3	7.2	Meets target	0	104	0
26	<a href="#">E207</a>	Classroom	Laney College	Building E	5	6.6	Meets target	0	838	0

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
27	<a href="#">E203</a>	Office	Laney College	Building E	3	4.9	Meets target	0	163	0
28	<a href="#">E251</a>	Lobby	Laney College	Building E	3	3.9	Meets target with mitigation	139	345	230
29	<a href="#">E251A</a>	Office	Laney College	Building E	3	3.2	Meets target	0	67	0
30	<a href="#">E251B</a>	Office	Laney College	Building E	3	3.5	Meets target	0	57	0
31	<a href="#">E251C</a>	Occupiable Storage (C	Laney College	Building E	3	8.7	Meets target	0	26	0
32	<a href="#">E251D</a>	Office	Laney College	Building E	3	3.9	Meets target	0	68	0
33	<a href="#">E251E</a>	Office	Laney College	Building E	3	4.1	Meets target	0	67	0
34	<a href="#">E251F</a>	Office	Laney College	Building E	3	4.9	Meets target	0	64	0
35	<a href="#">E253A</a>	Office	Laney College	Building E	3	4.0	Meets target	0	65	0
36	<a href="#">E253B</a>	Office	Laney College	Building E	3	4.7	Meets target	0	63	0