




## Ventilation Assessment Summary

### Ventilation Assessment

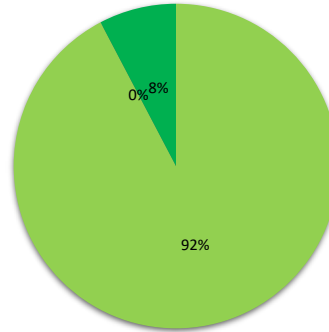

■ Meets target  
■ Does not meet target  
■ Meets target with mitigation

| #  | HVAC                               |                          | Site          |            | Air Changes |        |                              | Recommendation |             | Mitigation   |
|----|------------------------------------|--------------------------|---------------|------------|-------------|--------|------------------------------|----------------|-------------|--------------|
|    | Room                               | Type                     | Campus        | Building   | Target      | Actual | Result                       | Min. CADR      | Min. Supply | Applied CADR |
| 1  | <a href="#">F200</a>               | Classroom                | Laney College | Building F | 5           | 7.9    | Meets target                 | 0              | 540         | 0            |
| 2  | <a href="#">F201</a>               | Classroom                | Laney College | Building F | 7           | 9.1    | Meets target                 | 0              | 722         | 0            |
| 3  | <a href="#">F202</a>               | Classroom                | Laney College | Building F | 4           | 7.2    | Meets target                 | 0              | 661         | 0            |
| 4  | <a href="#">F203</a>               | Classroom                | Laney College | Building F | 4           | 9.4    | Meets target                 | 0              | 662         | 0            |
| 5  | <a href="#">F204</a>               | Classroom                | Laney College | Building F | 5           | 9.0    | Meets target                 | 0              | 544         | 0            |
| 6  | <a href="#">F205</a>               | Classroom                | Laney College | Building F | 4           | 8.6    | Meets target                 | 0              | 617         | 0            |
| 7  | <a href="#">F250</a>               | Office                   | Laney College | Building F | 3           | 6.1    | Meets target                 | 0              | 233         | 0            |
| 8  | <a href="#">F251</a>               | Classroom                | Laney College | Building F | 3           | 6.8    | Meets target                 | 0              | 529         | 0            |
| 9  | <a href="#">F252</a>               | Classroom                | Laney College | Building F | 3           | 7.7    | Meets target                 | 0              | 493         | 0            |
| 10 | <a href="#">B253</a>               | Classroom                | Laney College | Building F | 3           | 7.1    | Meets target                 | 0              | 493         | 0            |
| 11 | <a href="#">F254B</a>              | Office                   | Laney College | Building F | 3           | 6.8    | Meets target                 | 0              | 70          | 0            |
| 12 | <a href="#">F254</a>               | Classroom                | Laney College | Building F | 3           | 5.4    | Meets target                 | 0              | 896         | 0            |
| 13 | <a href="#">F255</a>               | Classroom                | Laney College | Building F | 5           | 6.9    | Meets target                 | 0              | 542         | 0            |
| 14 | <a href="#">F254C</a>              | Occupiable Storage (Dry) | Laney College | Building F | 3           | 7.2    | Meets target                 | 0              | 82          | 0            |
| 15 | <a href="#">F170</a>               | Office                   | Laney College | Building F | 3           | 3.0    | Meets target with mitigation | 855            | 941         | 920          |
| 16 | <a href="#">F170A</a>              | Computer Lab             | Laney College | Building F | 3           | 4.2    | Meets target                 | 0              | 692         | 0            |
| 17 | <a href="#">170 A Staff Office</a> | Computer                 | Laney College | Building F | 3           | 3.0    | Meets target                 | 18             | 346         | 0            |
| 18 | <a href="#">F170C</a>              | Computer Lab             | Laney College | Building F | 3           | 6.3    | Meets target                 | 0              | 1794        | 0            |
| 19 | <a href="#">F170D</a>              | Computer Lab             | Laney College | Building F | 3           | 4.6    | Meets target                 | 0              | 706         | 0            |
| 20 | <a href="#">F170B</a>              | Computer Lab             | Laney College | Building F | 3           | 4.1    | Meets target                 | 0              | 1674        | 0            |
| 21 | <a href="#">F170D.2</a>            | Conference               | Laney College | Building F | 3           | 8.8    | Meets target                 | 0              | 387         | 0            |
| 22 | <a href="#">F160</a>               | Locker Room              | Laney College | Building F | 3           | 4.7    | Meets target with mitigation | 294            | 323         | 460          |
| 23 | <a href="#">F150-152C</a>          | Wood/Metal Shop          | Laney College | Building F | 3           | 4.3    | Meets target                 | 0              | 11356       | 0            |
| 24 | <a href="#">F152B</a>              | Office                   | Laney College | Building F | 3           | 10.5   | Meets target                 | 0              | 74          | 0            |
| 25 | <a href="#">F153A</a>              | Office                   | Laney College | Building F | 3           | 5.0    | Meets target                 | 0              | 77          | 0            |
| 26 | <a href="#">F153B</a>              | Office                   | Laney College | Building F | 3           | 7.5    | Meets target                 | 0              | 62          | 0            |