




Ventilation Assessment Summary

Ventilation Assessment

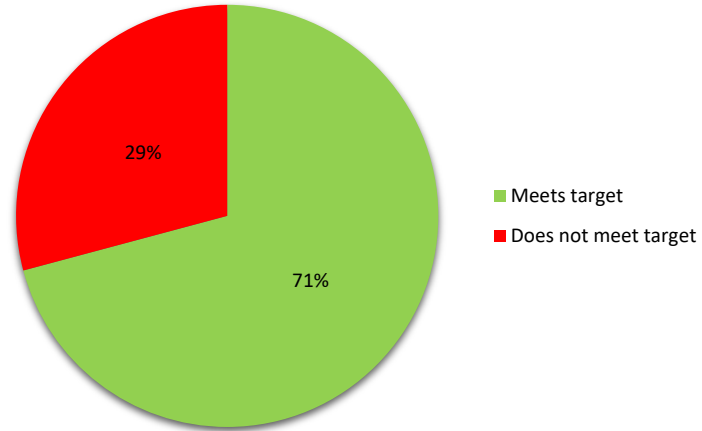

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	G201	Computer Lab	Laney College	G - South	3	7.7	Meets target	0	887
2	G202A	Office	Laney College	G - South	3	2.3	Does not meet target	13	66
3	G203	Classroom	Laney College	G - South	5	7.6	Meets target	0	482
4	G204	Office	Laney College	G - South	3	7.4	Meets target	0	107
5	G205	Computer Lab	Laney College	G - South	5	9.0	Meets target	0	547
6	G206	Classroom	Laney College	G - South	6	9.7	Meets target	0	521
7	G207	Classroom	Laney College	G - South	6	10.7	Meets target	0	508
8	G208	Office	Laney College	G - South	3	11.9	Meets target	0	108
9	G209	Classroom	Laney College	G - South	6	6.1	Meets target	0	641
10	G210	Classroom	Laney College	G - South	6	6.3	Meets target	0	523
11	G211	Classroom	Laney College	G - South	7	6.7	Does not meet target	20	557
12	G212	Office	Laney College	G - South	3	12.9	Meets target	0	108
13	G239	Classroom	Laney College	G - South	4	0.0	Does not meet target	871	959
14	G153	Computer Lab	Laney College	G - South	3	0.0	Does not meet target	227	250
15	G241	Classroom	Laney College	G - South	3	3.8	Meets target	0	733
16	G152	Office	Laney College	G - South	3	0.0	Does not meet target	58	64
17	G240	Classroom	Laney College	G - South	3	3.5	Meets target	0	655
18	G233	Classroom	Laney College	G - South	3	3.6	Meets target	0	439
19	G233A	Office	Laney College	G - South	3	9.3	Meets target	0	59
20	G243	Office	Laney College	G - South	3	6.7	Meets target	0	51

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
21	G237	Office	Laney College	G - South	3	10.4	Meets target	0	64
22	G238	Office	Laney College	G - South	3	8.7	Meets target	0	50
23	G242	Office	Laney College	G - South	3	0.0	Does not meet target	58	63
24	G246	Classroom	Laney College	G - South	6	3.1	Does not meet target	291	669