


## Ventilation Assessment Summary

### Ventilation Assessment

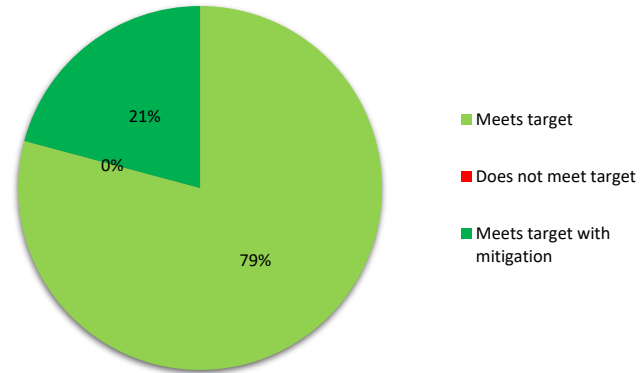

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	<a href="#">G201</a>	Computer Lab	Laney College	G - South	3	7.7	Meets target	0	887	0
2	<a href="#">G202A</a>	Office	Laney College	G - South	3	3.0	Meets target	13	66	0
3	<a href="#">G203</a>	Classroom	Laney College	G - South	5	7.6	Meets target	0	482	0
4	<a href="#">G204</a>	Office	Laney College	G - South	3	7.4	Meets target	0	107	0
5	<a href="#">G205</a>	Computer Lab	Laney College	G - South	5	9.0	Meets target	0	547	0
6	<a href="#">G206</a>	Classroom	Laney College	G - South	6	9.7	Meets target	0	521	0
7	<a href="#">G207</a>	Classroom	Laney College	G - South	6	10.7	Meets target	0	508	0
8	<a href="#">G208</a>	Office	Laney College	G - South	3	11.9	Meets target	0	108	0
9	<a href="#">G209</a>	Classroom	Laney College	G - South	6	6.1	Meets target	0	641	0
10	<a href="#">G210</a>	Classroom	Laney College	G - South	6	6.3	Meets target	0	523	0
11	<a href="#">G211</a>	Classroom	Laney College	G - South	7	7.0	Meets target	20	557	0
12	<a href="#">G212</a>	Office	Laney College	G - South	3	12.9	Meets target	0	108	0
13	<a href="#">G239</a>	Classroom	Laney College	G - South	4	5.3	Meets target with mitigation	871	959	1150
14	<a href="#">G153</a>	Computer Lab	Laney College	G - South	3	3.0	Meets target with mitigation	227	250	230
15	<a href="#">G241</a>	Classroom	Laney College	G - South	3	3.8	Meets target	0	733	0
16	<a href="#">G152</a>	Office	Laney College	G - South	3	11.8	Meets target with mitigation	58	64	230
17	<a href="#">G240</a>	Classroom	Laney College	G - South	3	3.5	Meets target	0	655	0
18	<a href="#">G233</a>	Classroom	Laney College	G - South	3	3.6	Meets target	0	439	0
19	<a href="#">G233A</a>	Office	Laney College	G - South	3	9.3	Meets target	0	59	0
20	<a href="#">G243</a>	Office	Laney College	G - South	3	6.7	Meets target	0	51	0
21	<a href="#">G237</a>	Office	Laney College	G - South	3	10.4	Meets target	0	64	0
22	<a href="#">G238</a>	Office	Laney College	G - South	3	8.7	Meets target	0	50	0
23	<a href="#">G242</a>	Office	Laney College	G - South	3	12.0	Meets target with mitigation	58	63	230
24	<a href="#">G246</a>	Classroom	Laney College	G - South	6	7.7	Meets target with mitigation	291	669	460