




Ventilation Assessment Summary

Ventilation Assessment

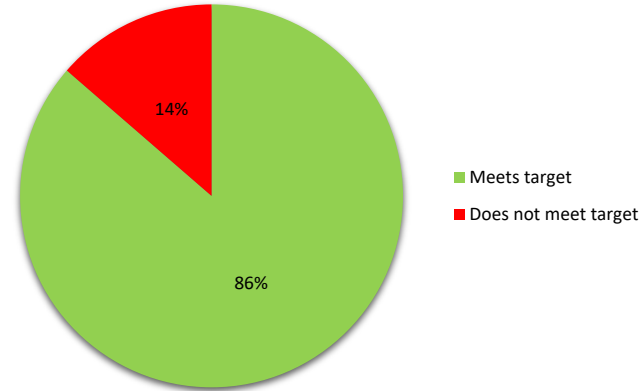

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	SC300A	Office	Laney College	Student Center	3	14.4	Meets target	0	382
2	SC401B	Conference	Laney College	Student Center	3	9.0	Meets target	0	258
3	SC411	Office	Laney College	Student Center	3	3.6	Meets target	0	276
4	SC417	Break room	Laney College	Student Center	3	23.7	Meets target	0	37
6	SC301A/SC301B/SC327	Office	Laney College	Student Center	3	12.6	Meets target	0	329
7	SC301	Conference	Laney College	Student Center	3	16.9	Meets target	0	152
8	SC413	Office	Laney College	Student Center	3	10.6	Meets target	0	72
9	Main Dining Area 201	Cafeteria	Laney College	Student Center	3	1.3	Does not meet target	2589	5110
10	Lounge & Dining 300	Cafeteria	Laney College	Student Center	3	2.1	Does not meet target	539	1971
11	SC201,SC202,SC203,SC212	Kitchen	Laney College	Student Center	3	4.0	Meets target	0	1343
12	SC414	Office	Laney College	Student Center	3	7.1	Meets target	0	54
13	SC415	Office	Laney College	Student Center	3	22.2	Meets target	0	63
14	STORAGE	Occupiable Storage (E	Laney College	Student Center	3	9.6	Meets target	0	45
15	SC123	Office	Laney College	Student Center	3	4.8	Meets target	0	85
16	SC110	Library	Laney College	Student Center	3	4.4	Meets target	0	2639
17	SC402	Office	Laney College	Student Center	3	3.4	Meets target	0	145
18	SC401A	Conference	Laney College	Student Center	3	2.8	Does not meet target	14	230
19	SC110A	Office	Laney College	Student Center	3	7.0	Meets target	0	115
20	SC412	Office	Laney College	Student Center	3	12.3	Meets target	0	70
22	SC130	Locker Room	Laney College	Student Center	3	5.7	Meets target	0	97
23	SC126	Locker Room	Laney College	Student Center	3	3.6	Meets target	0	129
24	SC 1	Kitchen	Laney College	Student Center	3	3.0	Meets target	0	1361