




Ventilation Assessment Summary

Ventilation Assessment

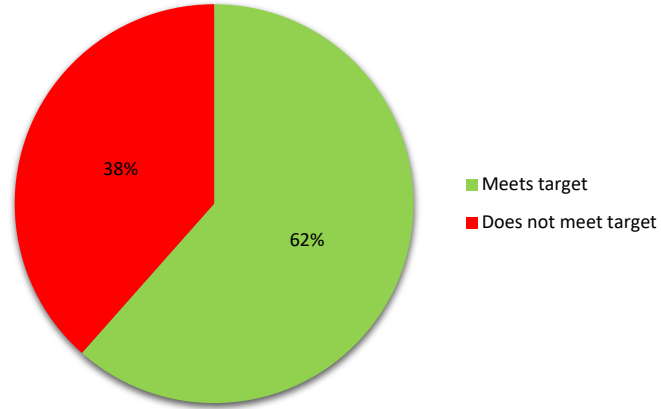

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
1	TH309	Office	Laney College	Theater	3	3.0	Meets target	0	51
2	TH304	Office	Laney College	Theater	3	3.3	Meets target	0	26
3	TH415	Stage/Studio	Laney College	Theater	3	3.4	Meets target	0	237
4	Theater Seating	Theatre	Laney College	Theater	3	2.8	Does not meet target	327	4634
5	1000	Stage/Studio	Laney College	Theater	3	1.3	Does not meet target	4233	8153
6	TH301	Office	Laney College	Theater	3	6.1	Meets target	0	27
7	TH302	Office	Laney College	Theater	3	3.9	Meets target	0	129
8	TH303	Office	Laney College	Theater	3	12.3	Meets target	0	75
9	TH305	Occupiable Storage (C	Laney College	Theater	3	3.0	Meets target	0	79
10	TH306	Computer	Laney College	Theater	3	7.8	Meets target	0	118
11	TH306A	Stage/Studio	Laney College	Theater	3	12.7	Meets target	0	407
12	TH307	Occupiable Storage (C	Laney College	Theater	3	1.6	Does not meet target	49	116
13	TH311	Office	Laney College	Theater	3	9.9	Meets target	0	52
14	TH314	Occupiable Storage (C	Laney College	Theater	3	1.2	Does not meet target	353	664
15	TH319	Classroom	Laney College	Theater	3	2.3	Does not meet target	117	522
16	TH409	Office	Laney College	Theater	3	7.1	Meets target	0	36
17	TH413	Office	Laney College	Theater	3	3.8	Meets target	0	131
18	TH423	Classroom	Laney College	Theater	3	1.2	Does not meet target	310	564
19	TH425	Classroom	Laney College	Theater	6	3.7	Does not meet target	147	416
20	TH426	Classroom	Laney College	Theater	5	3.3	Does not meet target	123	400
21	TH-416	Occupiable Storage (C	Laney College	Theater	3	9.1	Meets target	0	139
22	TH-107	Locker Room	Laney College	Theater	3	2.6	Does not meet target	17	142

#	HVAC		Site		Air Changes			Recommendation	
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply
23	TH-105	Occupiable Storage	Laney College	Theater	3	3.4	Meets target	0	106
24	TH-112	Locker Room	Laney College	Theater	3	3.9	Meets target	0	114
25	TH-108	Beauty and nail salon	Laney College	Theater	3	2.8	Does not meet target	6	89
26	TH-200	Office	Laney College	Theater	3	4.8	Meets target	0	213