


Ventilation Assessment Summary

Ventilation Assessment

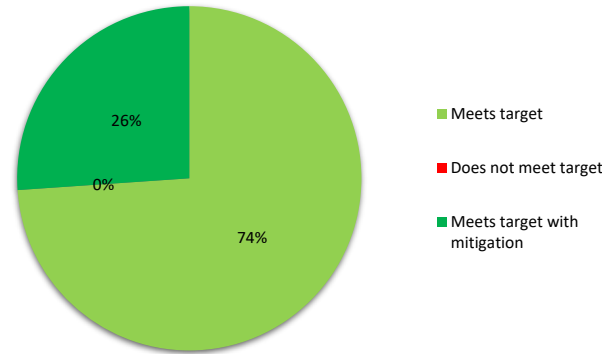

#	HVAC		Site		Air Changes			Recommendation		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	TH309	Office	Laney College	Theater	3	3.0	Meets target	0	51	0
2	TH304	Office	Laney College	Theater	3	3.3	Meets target	0	26	0
3	TH415	Stage/Studio	Laney College	Theater	3	3.4	Meets target	0	237	0
4	Theater Seating	Theatre	Laney College	Theater	3	3.1	Meets target with mitigation	327	4634	460
5	1000	Stage/Studio	Laney College	Theater	3	3.0	Meets target with mitigation	4233	8153	4260
6	TH301	Office	Laney College	Theater	3	6.1	Meets target	0	27	0
7	TH302	Office	Laney College	Theater	3	3.9	Meets target	0	129	0
8	TH303	Office	Laney College	Theater	3	12.3	Meets target	0	75	0
9	TH306	Computer	Laney College	Theater	3	7.8	Meets target	0	118	0
10	TH306A	Stage/Studio	Laney College	Theater	3	12.7	Meets target	0	407	0
11	TH311	Office	Laney College	Theater	3	9.9	Meets target	0	52	0
12	TH319	Classroom	Laney College	Theater	3	3.7	Meets target with mitigation	117	522	230
13	TH409	Office	Laney College	Theater	3	7.1	Meets target	0	36	0
14	TH413	Office	Laney College	Theater	3	3.8	Meets target	0	131	0
15	TH423	Classroom	Laney College	Theater	3	3.9	Meets target with mitigation	310	564	460
16	TH425	Classroom	Laney College	Theater	6	7.3	Meets target with mitigation	147	416	230
17	TH426	Classroom	Laney College	Theater	5	6.5	Meets target with mitigation	123	400	230
18	TH-416	Occupiable Storage (C	Laney College	Theater	3	9.1	Meets target	0	139	0
19	TH-107	Locker Room	Laney College	Theater	3	3.0	Meets target	17	142	0
20	TH-105	Occupiable Storage (C	Laney College	Theater	3	3.4	Meets target	0	106	0
21	TH-112	Locker Room	Laney College	Theater	3	3.9	Meets target	0	114	0
22	TH-108	Beauty and nail salon:	Laney College	Theater	3	3.0	Meets target	6	89	0
23	TH-200	Office	Laney College	Theater	3	4.8	Meets target	0	213	0