


## Ventilation Assessment Summary

### Ventilation Assessment

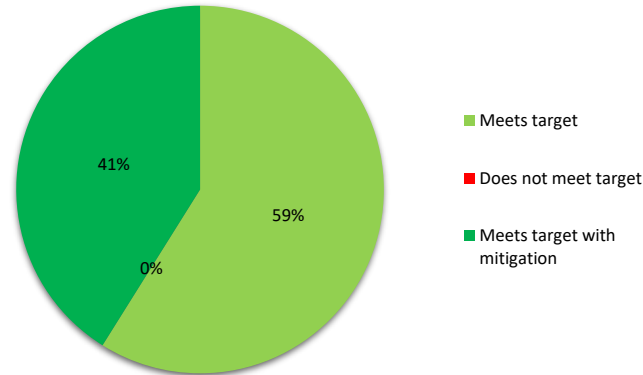

| #  | HVAC |            | Site          |          | Air Changes |        |                              | Recommendation |             | Mitigation   |
|----|------|------------|---------------|----------|-------------|--------|------------------------------|----------------|-------------|--------------|
|    | Room | Type       | Campus        | Building | Target      | Actual | Result                       | Min. CADR      | Min. Supply | Applied CADR |
| 1  | 850  | Conference | Laney College | Tower    | 3           | 4.9    | Meets target                 | 0              | 296         | 0            |
| 2  | 803  | Office     | Laney College | Tower    | 3           | 12.2   | Meets target                 | 0              | 65          | 0            |
| 3  | 801  | Conference | Laney College | Tower    | 3           | 5.7    | Meets target with mitigation | 19             | 257         | 230          |
| 4  | 804  | Office     | Laney College | Tower    | 3           | 6.5    | Meets target                 | 0              | 65          | 0            |
| 5  | 806  | Office     | Laney College | Tower    | 3           | 13.6   | Meets target with mitigation | 22             | 65          | 230          |
| 6  | 808  | Conference | Laney College | Tower    | 3           | 3.1    | Meets target                 | 0              | 135         | 0            |
| 7  | 805  | Office     | Laney College | Tower    | 3           | 8.1    | Meets target                 | 0              | 65          | 0            |
| 8  | 807  | Office     | Laney College | Tower    | 3           | 13.3   | Meets target with mitigation | 26             | 65          | 230          |
| 9  | 809  | Office     | Laney College | Tower    | 3           | 8.7    | Meets target                 | 0              | 65          | 0            |
| 10 | 811  | Office     | Laney College | Tower    | 3           | 7.1    | Meets target                 | 0              | 66          | 0            |
| 26 | 810  | Office     | Laney College | Tower    | 3           | 8.8    | Meets target                 | 0              | 84          | 0            |
| 24 | 813  | Office     | Laney College | Tower    | 3           | 7.9    | Meets target                 | 0              | 65          | 0            |
| 28 | 810B | Office     | Laney College | Tower    | 3           | 7.9    | Meets target                 | 0              | 84          | 0            |
| 31 | 815  | Office     | Laney College | Tower    | 3           | 5.2    | Meets target with mitigation | 132            | 145         | 230          |
| 11 | 713  | Office     | Laney College | Tower    | 3           | 6.3    | Meets target                 | 0              | 82          | 0            |
| 12 | 711  | Office     | Laney College | Tower    | 3           | 13.1   | Meets target with mitigation | 33             | 64          | 230          |
| 13 | 709  | Office     | Laney College | Tower    | 3           | 13.1   | Meets target with mitigation | 32             | 65          | 230          |
| 14 | 707  | Office     | Laney College | Tower    | 3           | 7.3    | Meets target with mitigation | 57             | 134         | 230          |
| 15 | 705  | Office     | Laney College | Tower    | 3           | 13.4   | Meets target with mitigation | 26             | 65          | 230          |
| 16 | 703  | Office     | Laney College | Tower    | 3           | 13.4   | Meets target with mitigation | 25             | 65          | 230          |
| 17 | 701  | Office     | Laney College | Tower    | 3           | 3.7    | Meets target                 | 0              | 161         | 0            |
| 18 | 702  | Office     | Laney College | Tower    | 3           | 8.9    | Meets target                 | 0              | 64          | 0            |
| 19 | 704  | Office     | Laney College | Tower    | 3           | 8.1    | Meets target                 | 0              | 65          | 0            |
| 20 | 706  | Break room | Laney College | Tower    | 3           | 7.8    | Meets target                 | 0              | 65          | 0            |
| 21 | 708  | Office     | Laney College | Tower    | 3           | 6.6    | Meets target                 | 0              | 65          | 0            |
| 22 | 710  | Office     | Laney College | Tower    | 3           | 6.9    | Meets target                 | 0              | 149         | 0            |

| #  | HVAC                |              | Site          |          | Air Changes |        |                              | Recommendation |             | Mitigation   |
|----|---------------------|--------------|---------------|----------|-------------|--------|------------------------------|----------------|-------------|--------------|
|    | Room                | Type         | Campus        | Building | Target      | Actual | Result                       | Min. CADR      | Min. Supply | Applied CADR |
| 23 | <a href="#">750</a> | Conference   | Laney College | Tower    | 3           | 3.4    | Meets target                 | 0              | 205         | 0            |
| 25 | <a href="#">712</a> | Office       | Laney College | Tower    | 3           | 9.1    | Meets target                 | 0              | 64          | 0            |
| 27 | <a href="#">714</a> | Office       | Laney College | Tower    | 3           | 12.3   | Meets target with mitigation | 56             | 62          | 230          |
| 30 | <a href="#">752</a> | Office       | Laney College | Tower    | 3           | 4.8    | Meets target                 | 0              | 89          | 0            |
| 29 | <a href="#">650</a> | Break room   | Laney College | Tower    | 3           | 4.6    | Meets target                 | 0              | 150         | 0            |
| 32 | <a href="#">651</a> | Office       | Laney College | Tower    | 3           | 9.6    | Meets target with mitigation | 19             | 105         | 230          |
| 33 | <a href="#">613</a> | Computer Lab | Laney College | Tower    | 3           | 5.4    | Meets target with mitigation | 25             | 285         | 230          |
| 36 | <a href="#">611</a> | Office       | Laney College | Tower    | 3           | 3.3    | Meets target with mitigation | 32             | 66          | 38           |
| 37 | <a href="#">609</a> | Office       | Laney College | Tower    | 3           | 12.7   | Meets target with mitigation | 37             | 65          | 230          |
| 38 | <a href="#">607</a> | Office       | Laney College | Tower    | 3           | 13.0   | Meets target with mitigation | 31             | 65          | 230          |
| 39 | <a href="#">605</a> | Office       | Laney College | Tower    | 3           | 13.0   | Meets target with mitigation | 33             | 65          | 230          |
| 40 | <a href="#">603</a> | Office       | Laney College | Tower    | 3           | 12.9   | Meets target with mitigation | 32             | 66          | 230          |
| 41 | <a href="#">601</a> | Office       | Laney College | Tower    | 3           | 4.6    | Meets target                 | 0              | 140         | 0            |
| 50 | <a href="#">608</a> | Office       | Laney College | Tower    | 3           | 30.4   | Meets target                 | 0              | 65          | 0            |
| 51 | <a href="#">610</a> | Office       | Laney College | Tower    | 3           | 13.0   | Meets target with mitigation | 33             | 65          | 230          |
| 43 | <a href="#">604</a> | Office       | Laney College | Tower    | 3           | 11.6   | Meets target with mitigation | 59             | 65          | 230          |
| 53 | <a href="#">612</a> | Office       | Laney College | Tower    | 3           | 7.5    | Meets target                 | 0              | 65          | 0            |
| 56 | <a href="#">614</a> | Computer Lab | Laney College | Tower    | 3           | 5.5    | Meets target with mitigation | 252            | 277         | 460          |
| 48 | <a href="#">606</a> | Office       | Laney College | Tower    | 3           | 11.6   | Meets target with mitigation | 59             | 65          | 230          |
| 42 | <a href="#">602</a> | Office       | Laney College | Tower    | 3           | 11.8   | Meets target with mitigation | 59             | 64          | 230          |
| 34 | <a href="#">511</a> | Office       | Laney College | Tower    | 3           | 6.2    | Meets target                 | 0              | 64          | 0            |
| 35 | <a href="#">513</a> | Computer Lab | Laney College | Tower    | 4           | 4.1    | Meets target                 | 0              | 255         | 0            |
| 44 | <a href="#">509</a> | Office       | Laney College | Tower    | 3           | 6.2    | Meets target                 | 0              | 65          | 0            |
| 45 | <a href="#">507</a> | Office       | Laney College | Tower    | 3           | 5.5    | Meets target                 | 0              | 65          | 0            |
| 46 | <a href="#">503</a> | Office       | Laney College | Tower    | 3           | 5.4    | Meets target                 | 0              | 65          | 0            |
| 47 | <a href="#">501</a> | Office       | Laney College | Tower    | 3           | 4.5    | Meets target                 | 0              | 147         | 0            |
| 49 | <a href="#">502</a> | Office       | Laney College | Tower    | 3           | 5.2    | Meets target                 | 0              | 65          | 0            |
| 52 | <a href="#">504</a> | Office       | Laney College | Tower    | 3           | 6.7    | Meets target                 | 0              | 65          | 0            |
| 54 | <a href="#">506</a> | Office       | Laney College | Tower    | 3           | 6.6    | Meets target                 | 0              | 65          | 0            |
| 55 | <a href="#">508</a> | Office       | Laney College | Tower    | 3           | 3.6    | Meets target                 | 0              | 65          | 0            |
| 62 | <a href="#">550</a> | Office       | Laney College | Tower    | 3           | 7.3    | Meets target with mitigation | 41             | 145         | 230          |
| 63 | <a href="#">551</a> | Office       | Laney College | Tower    | 3           | 5.3    | Meets target                 | 0              | 61          | 0            |
| 64 | <a href="#">552</a> | Office       | Laney College | Tower    | 3           | 3.2    | Meets target                 | 0              | 109         | 0            |
| 57 | <a href="#">510</a> | Office       | Laney College | Tower    | 3           | 3.9    | Meets target                 | 0              | 65          | 0            |
| 58 | <a href="#">512</a> | Office       | Laney College | Tower    | 3           | 3.4    | Meets target                 | 0              | 65          | 0            |
| 59 | <a href="#">514</a> | Computer Lab | Laney College | Tower    | 4           | 4.0    | Meets target with mitigation | 232            | 255         | 230          |
| 60 | <a href="#">403</a> | Office       | Laney College | Tower    | 3           | 3.2    | Meets target                 | 0              | 68          | 0            |
| 61 | <a href="#">401</a> | Office       | Laney College | Tower    | 3           | 11.8   | Meets target with mitigation | 0              | 130         | 230          |
| 65 | <a href="#">413</a> | Computer Lab | Laney College | Tower    | 3           | 5.9    | Meets target with mitigation | 71             | 182         | 230          |
| 66 | <a href="#">411</a> | Office       | Laney College | Tower    | 3           | 12.8   | Meets target with mitigation | 38             | 65          | 230          |
| 67 | <a href="#">409</a> | Office       | Laney College | Tower    | 3           | 12.4   | Meets target with mitigation | 43             | 65          | 230          |
| 68 | <a href="#">407</a> | Office       | Laney College | Tower    | 3           | 11.7   | Meets target with mitigation | 59             | 65          | 230          |

| #  | HVAC                |        | Site          |          | Air Changes |        |                              | Recommendation |             | Mitigation   |
|----|---------------------|--------|---------------|----------|-------------|--------|------------------------------|----------------|-------------|--------------|
|    | Room                | Type   | Campus        | Building | Target      | Actual | Result                       | Min. CADR      | Min. Supply | Applied CADR |
| 69 | <a href="#">405</a> | Office | Laney College | Tower    | 3           | 11.6   | Meets target with mitigation | 59             | 59          | 230          |
| 70 | <a href="#">402</a> | Office | Laney College | Tower    | 3           | 7.5    | Meets target                 | 0              | 64          | 0            |
| 71 | <a href="#">404</a> | Office | Laney College | Tower    | 3           | 6.8    | Meets target                 | 0              | 65          | 0            |
| 72 | <a href="#">406</a> | Office | Laney College | Tower    | 3           | 7.0    | Meets target                 | 0              | 65          | 0            |
| 73 | <a href="#">408</a> | Office | Laney College | Tower    | 3           | 6.1    | Meets target                 | 0              | 65          | 0            |