




Ventilation Assessment Summary

Ventilation Assessment

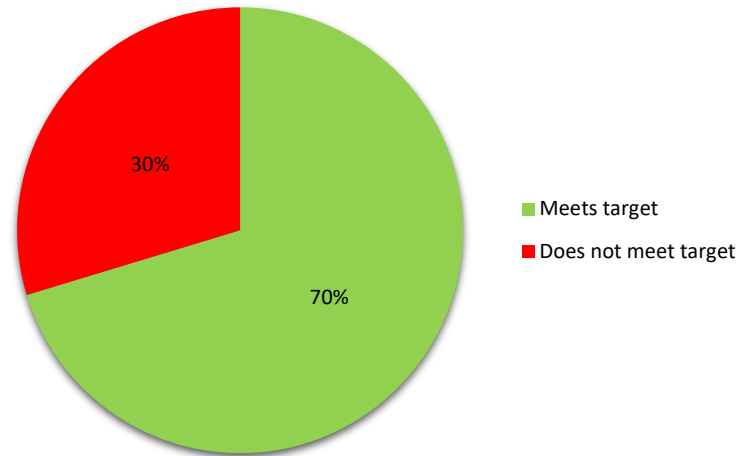

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
1	850	Conference	Laney College	Tower	3	4.9	Meets target	0	
2	803	Office	Laney College	Tower	3	14.7	Meets target	0	
3	801	Conference	Laney College	Tower	3	2.8	Does not meet target	19	20
4	804	Office	Laney College	Tower	3	6.5	Meets target	0	
5	806	Office	Laney College	Tower	3	1.9	Does not meet target	22	40
6	808	Conference	Laney College	Tower	3	3.1	Meets target	0	
7	805	Office	Laney College	Tower	3	8.1	Meets target	0	
8	807	Office	Laney College	Tower	3	1.7	Does not meet target	26	40
9	809	Office	Laney College	Tower	3	8.7	Meets target	0	
10	811	Office	Laney College	Tower	3	7.1	Meets target	0	
26	810	Office	Laney College	Tower	3	8.8	Meets target	0	
24	813	Office	Laney College	Tower	3	7.9	Meets target	0	
28	810B	Office	Laney College	Tower	3	7.9	Meets target	0	
11	713	Office	Laney College	Tower	3	6.3	Meets target	0	
12	711	Office	Laney College	Tower	3	1.3	Does not meet target	33	40
13	709	Office	Laney College	Tower	3	1.4	Does not meet target	32	40
14	707	Office	Laney College	Tower	3	1.6	Does not meet target	57	70
15	705	Office	Laney College	Tower	3	1.7	Does not meet target	26	40

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
16	703	Office	Laney College	Tower	3	1.8	Does not meet target	25	40
17	701	Office	Laney College	Tower	3	3.7	Meets target	0	
18	702	Office	Laney College	Tower	3	8.9	Meets target	0	
19	704	Office	Laney College	Tower	3	8.1	Meets target	0	
20	706	Break room	Laney College	Tower	3	7.8	Meets target	0	
21	708	Office	Laney College	Tower	3	6.6	Meets target	0	
22	710	Office	Laney College	Tower	3	6.9	Meets target	0	
23	750	Conference	Laney College	Tower	3	3.4	Meets target	0	
25	712	Office	Laney College	Tower	3	9.1	Meets target	0	
30	752	Office	Laney College	Tower	3	4.8	Meets target	0	
29	650	Break room	Laney College	Tower	3	4.6	Meets target	0	
32	651	Office	Laney College	Tower	3	2.4	Does not meet target	19	20
33	613	Computer Lab	Laney College	Tower	3	2.7	Does not meet target	25	40
36	611	Office	Laney College	Tower	3	3.3	Meets target	32	40
37	609	Office	Laney College	Tower	3	1.1	Does not meet target	37	40
38	607	Office	Laney College	Tower	3	1.4	Does not meet target	31	40
39	605	Office	Laney College	Tower	3	1.3	Does not meet target	33	40
40	603	Office	Laney College	Tower	3	1.4	Does not meet target	32	40
41	601	Office	Laney College	Tower	3	4.6	Meets target	0	
50	608	Office	Laney College	Tower	3	30.4	Meets target	0	
51	610	Office	Laney College	Tower	3	1.3	Does not meet target	33	40
53	612	Office	Laney College	Tower	3	7.5	Meets target	0	
34	511	Office	Laney College	Tower	3	6.2	Meets target	0	
35	513	Computer Lab	Laney College	Tower	4	4.1	Meets target	0	
44	509	Office	Laney College	Tower	3	6.2	Meets target	0	
45	507	Office	Laney College	Tower	3	5.5	Meets target	0	
46	503	Office	Laney College	Tower	3	5.4	Meets target	0	
47	501	Office	Laney College	Tower	3	4.5	Meets target	0	

#	HVAC		Site		Air Changes				PAC
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	CADR
49	502	Office	Laney College	Tower	3	5.2	Meets target	0	
52	504	Office	Laney College	Tower	3	6.7	Meets target	0	
54	506	Office	Laney College	Tower	3	6.6	Meets target	0	
55	508	Office	Laney College	Tower	3	3.6	Meets target	0	
62	550	Office	Laney College	Tower	3	2.1	Does not meet target	41	70
63	551	Office	Laney College	Tower	3	5.3	Meets target	0	
64	552	Office	Laney College	Tower	3	3.2	Meets target	0	
57	510	Office	Laney College	Tower	3	3.9	Meets target	0	
58	512	Office	Laney College	Tower	3	3.4	Meets target	0	
60	403	Office	Laney College	Tower	3	3.2	Meets target	0	
61	401	Office	Laney College	Tower	3	12.3	Meets target	0	
65	413	Computer Lab	Laney College	Tower	3	1.7	Does not meet target	71	100
66	411	Office	Laney College	Tower	3	1.1	Does not meet target	38	40
67	409	Office	Laney College	Tower	3	0.8	Does not meet target	43	70
70	402	Office	Laney College	Tower	3	7.5	Meets target	0	
71	404	Office	Laney College	Tower	3	6.8	Meets target	0	
72	406	Office	Laney College	Tower	3	7.0	Meets target	0	
73	408	Office	Laney College	Tower	3	6.1	Meets target	0	