


Ventilation Assessment Summary

Ventilation Assessment

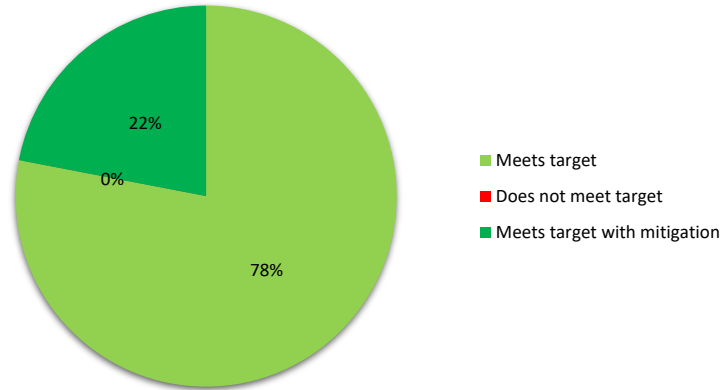

#	Site				Air Changes			Recommendations		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
1	A100	Classroom	Merritt College	A	3	3.3	Meets target with mitigation	577	1147	668
2	A106	Classroom (5-8)	Merritt College	A	3	3.1	Meets target with mitigation	2780	3060	2850
3	A120	Office	Merritt College	A	3	3.4	Meets target with mitigation	747	822	837
4	A122	Wood/Metal Shop	Merritt College	A	3	3.8	Meets target with mitigation	2987	3287	3800
5	A133	Classroom	Merritt College	A	3	3.3	Meets target with mitigation	3430	3775	3800
6	A218	Classroom	Merritt College	A	3	3.8	Meets target with mitigation	451	497	564
7	D187	Office	Merritt College	D	3	4.0	Meets target	0	588	0
8	D181	Conference	Merritt College	D	3	3.7	Meets target with mitigation	450	495	558
9	D178	Computer Lab	Merritt College	D	3	3.9	Meets target with mitigation	563	619	725
10	D216	Office	Merritt College	D	3	12.8	Meets target with mitigation	70	77	300
11	Q105	Office	Merritt College	Q	3	4.4	Meets target with mitigation	92	101	134
12	Q209	Office	Merritt College	Q	3	3.6	Meets target	0	174	0
13	Q224	Office	Merritt College	Q	3	3.2	Meets target	0	70	0
14	Q225	Office	Merritt College	Q	3	4.5	Meets target	0	48	0
15	Q226	Office	Merritt College	Q	3	4.0	Meets target	0	43	0
16	Q227	Office	Merritt College	Q	3	3.3	Meets target	0	55	0
17	Q230	Office	Merritt College	Q	3	4.3	Meets target	0	47	0
18	Q231	Office	Merritt College	Q	3	4.1	Meets target	0	77	0
19	Q232	Office	Merritt College	Q	3	4.3	Meets target	0	74	0
20	Q300	Office	Merritt College	Q	3	7.3	Meets target	0	1089	0
21	Q214	Office	Merritt College	Q	3	10.1	Meets target	0	85	0
22	Q311	Conference	Merritt College	Q	3	6.7	Meets target	0	210	0
23	Q107	Office	Merritt College	Q	3	6.2	Meets target	0	129	0
24	Q106	Office	Merritt College	Q	3	10.7	Meets target	0	405	0

#	Site				Air Changes			Recommendations		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
25	L121	Office	Merritt College	L	3	5.0	Meets target	0	105	0
26	L123	Office	Merritt College	L	3	5.1	Meets target	0	105	0
27	L126	Library	Merritt College	L	3	5.8	Meets target	0	785	0
28	L131	Office	Merritt College	L	3	4.8	Meets target	0	516	0
29	L304	Office	Merritt College	L	3	4.8	Meets target	0	555	0
30	L304A	Office	Merritt College	L	3	3.1	Meets target	0	125	0
31	L100	Library	Merritt College	L	3	3.1	Meets target with mitigation	148	915	167
32	L200	Library	Merritt College	L	3	3.3	Meets target	0	6764	0
33	L302	Office	Merritt College	L	3	3.2	Meets target	0	99	0
34	S341	Office	Merritt College	S	3	4.3	Meets target	0	52	0
35	S343	Reception Areas	Merritt College	S	3	3.4	Meets target	0	477	0
36	S440	Office	Merritt College	S	3	5.7	Meets target with mitigation	40	153	167
37	S404	Science Lab	Merritt College	S	3	16.3	Meets target	0	434	0
38	S441	Office	Merritt College	S	3	6.5	Meets target with mitigation	25	136	167
39	S338	Office	Merritt College	S	3	6.0	Meets target	0	53	0
40	S337	Office	Merritt College	S	3	4.5	Meets target	0	61	0
41	S335	Office	Merritt College	S	3	3.2	Meets target	0	132	0
42	S336	Office	Merritt College	S	3	3.0	Meets target	0	59	0
43	S330	Occupiable Storage (C	Merritt College	S	3	6.1	Meets target	0	79	0
44	P103	Computer Lab	Merritt College	P	4	11.2	Meets target	0	947	0
45	P107	Computer Lab	Merritt College	P	4	8.0	Meets target	0	319	0
46	P105	Office	Merritt College	P	3	9.9	Meets target	0	68	0
47	P108	Classroom	Merritt College	P	5	14.4	Meets target	0	399	0
48	P306	Computer Lab	Merritt College	P	3	3.7	Meets target with mitigation	358	394	446
49	P111	Classroom	Merritt College	P	3	10.5	Meets target	0	706	0
50	P112	Office	Merritt College	P	3	10.6	Meets target	0	325	0
51	P302	Office	Merritt College	P	3	7.1	Meets target	0	62	0
52	P303	Office	Merritt College	P	3	7.5	Meets target	0	64	0
53	P304	Office	Merritt College	P	3	17.8	Meets target	0	64	0
54	P305	Computer Lab	Merritt College	P	4	8.4	Meets target	0	370	0
55	P307	Classroom	Merritt College	P	5	5.2	Meets target	0	2843	0
56	P308	Office	Merritt College	P	3	3.1	Meets target	0	214	0
57	R124A	Office	Merritt College	R	3	12.5	Meets target with mitigation	40	44	167
58	R124B	Office	Merritt College	R	3	14.8	Meets target	0	73	0
59	R124C	Office	Merritt College	R	3	5.7	Meets target	0	35	0
60	R125	Office	Merritt College	R	3	3.1	Meets target	0	294	0
61	R128A	Office	Merritt College	R	3	6.4	Meets target	0	38	0
62	R127	Office	Merritt College	R	3	3.8	Meets target with mitigation	77	387	167
63	R128B	Office	Merritt College	R	3	10.2	Meets target	0	85	0
64	R129	Office	Merritt College	R	3	3.4	Meets target	0	142	0

#	Site				Air Changes			Recommendations		Mitigation
	Room	Type	Campus	Building	Target	Actual	Result	Min. CADR	Min. Supply	Applied CADR
65	R109F	Office	Merritt College	R	3	10.5	Meets target	0	63	0
66	R109J	Office	Merritt College	R	3	3.9	Meets target	0	59	0
67	R109H	Office	Merritt College	R	3	3.9	Meets target	0	58	0
68	R109T	Office	Merritt College	R	3	10.9	Meets target with mitigation	16	63	167
69	R109K	Office	Merritt College	R	3	5.3	Meets target	0	54	0
70	R109L	Office	Merritt College	R	3	11.1	Meets target	0	67	0
71	R109M	Office	Merritt College	R	3	6.4	Meets target	0	68	0
72	R109Q	Office	Merritt College	R	3	6.5	Meets target	0	68	0
73	R109R	Office	Merritt College	R	3	7.7	Meets target	0	69	0
74	R109U	Office	Merritt College	R	3	10.7	Meets target with mitigation	21	63	167
75	R113	Office	Merritt College	R	3	3.2	Meets target	0	789	0
76	R105J	Office	Merritt College	R	3	7.8	Meets target with mitigation	64	71	167
77	R105H	Office	Merritt College	R	3	3.1	Meets target	0	41	0
78	R105E	Office	Merritt College	R	3	7.5	Meets target	0	64	0
79	R105F	Office	Merritt College	R	3	4.1	Meets target	0	41	0
80	R105B	Office	Merritt College	R	3	3.0	Meets target	0	57	0
81	R105C	Office	Merritt College	R	3	3.5	Meets target	0	56	0
82	R109B	Office	Merritt College	R	3	3.4	Meets target	0	69	0
83	R109A	Office	Merritt College	R	3	3.6	Meets target with mitigation	304	792	446
84	R109N	Office	Merritt College	R	3	6.9	Meets target	0	67	0
85	R109P	Conference	Merritt College	R	3	6.6	Meets target	0	65	0
86	R113E	Office	Merritt College	R	3	5.9	Meets target	0	145	0
87	R113G	Office	Merritt College	R	3	3.8	Meets target	0	85	0
88	R106F	Office	Merritt College	R	3	9.1	Meets target	0	156	0
89	R109C	Office	Merritt College	R	3	3.3	Meets target	0	69	0
90	R109D	Office	Merritt College	R	3	3.0	Meets target	0	69	0
91	R105D	Office	Merritt College	R	3	7.7	Meets target	0	64	0
91	91	91	91	91	91	91	91			